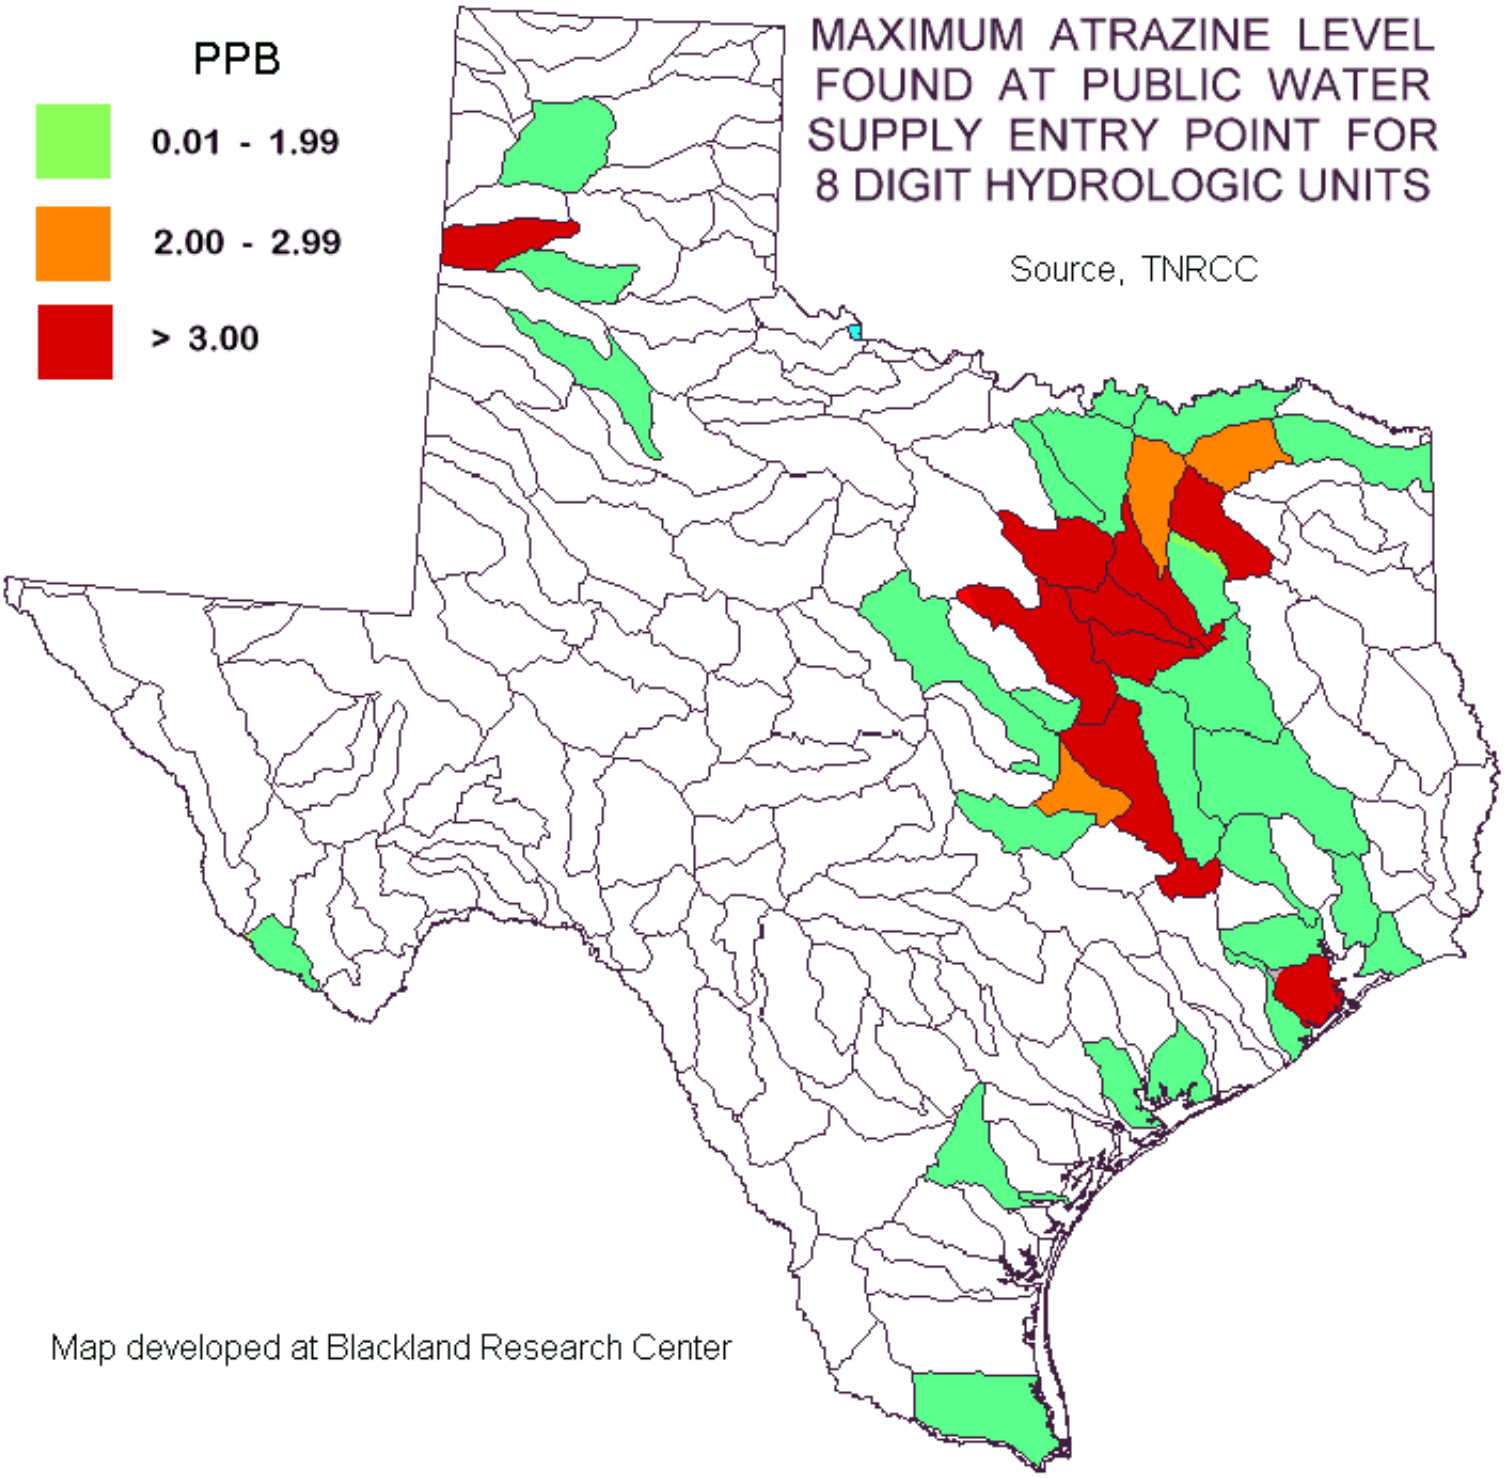
PPB
0.01 - 1.99
2.00 - 2.99
> 3.00
MAXIMUM ATRAZINE LEVEL FOUND AT PUBLIC WATER SUPPLY ENTRY POINT FOR 8 DIGIT HYDROLOGIC UNITS
Source, TNRCC
Map developed at Blackland Research Center