

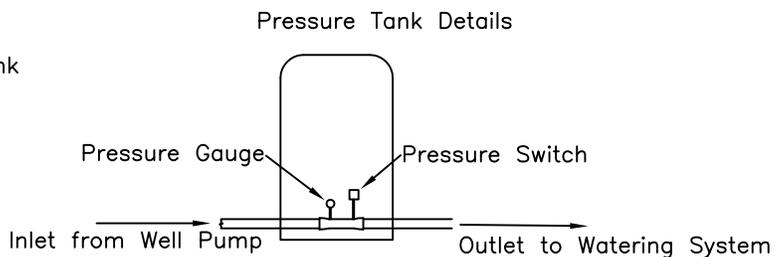
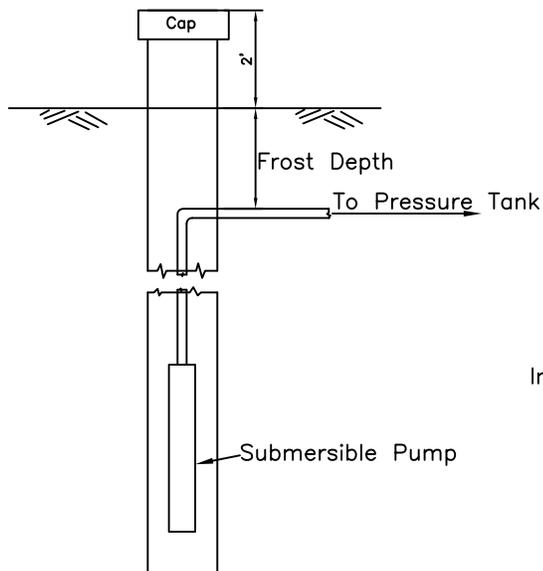


Typical Well Pump and Pressure Tank

Submersible Pump System

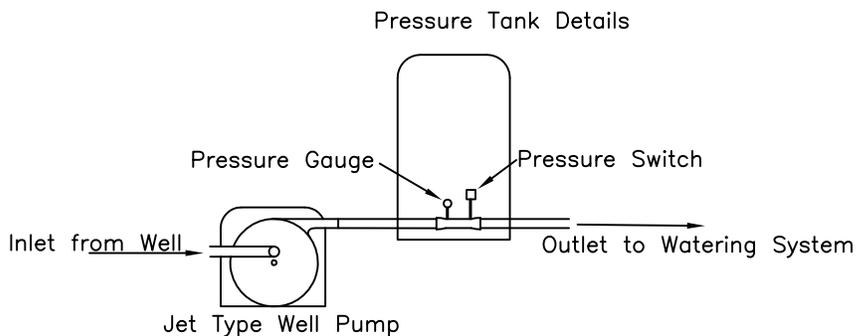

Jet Pump System

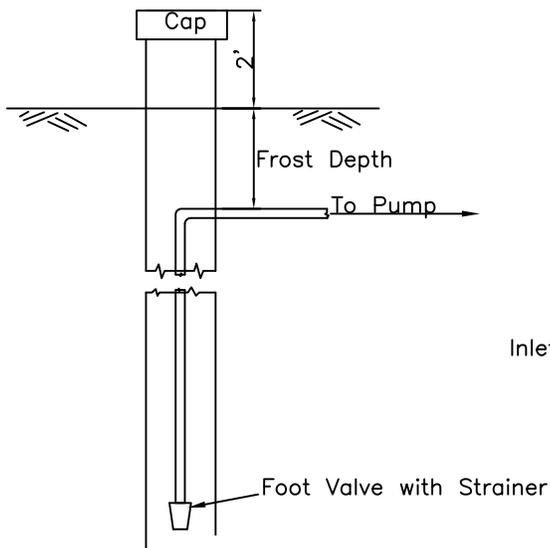

Not to Scale
Standard design, Must be adapted to specific site

County	Frost Depth
York	40"
Cumberland, Waldo, Lincoln, Kennebec Southern Oxford, Knox, Hancock Androscoggin, Sagadahoc,	50"
Northern Oxford, Franklin, Somerset, Piscataquis, Southern Aroostook Penobscot, Wasington	55"
Northern Aroostook	60"

All system components must be protected from freezing
 Pressure switch settings, On pressure ____ Off pressure ____
 Min. Pump flow ____gpm at ____ ft. head
 Pressure Tank Volume ____ gallons
 Depth to Intake ____ ft.



Date	File Name
Designed _____	Drawing Name
Drawn <u>Standard</u>	ME-ENG-WPPT
Checked _____	Date
Approved _____	Rev. 2/2010
	Sheet of