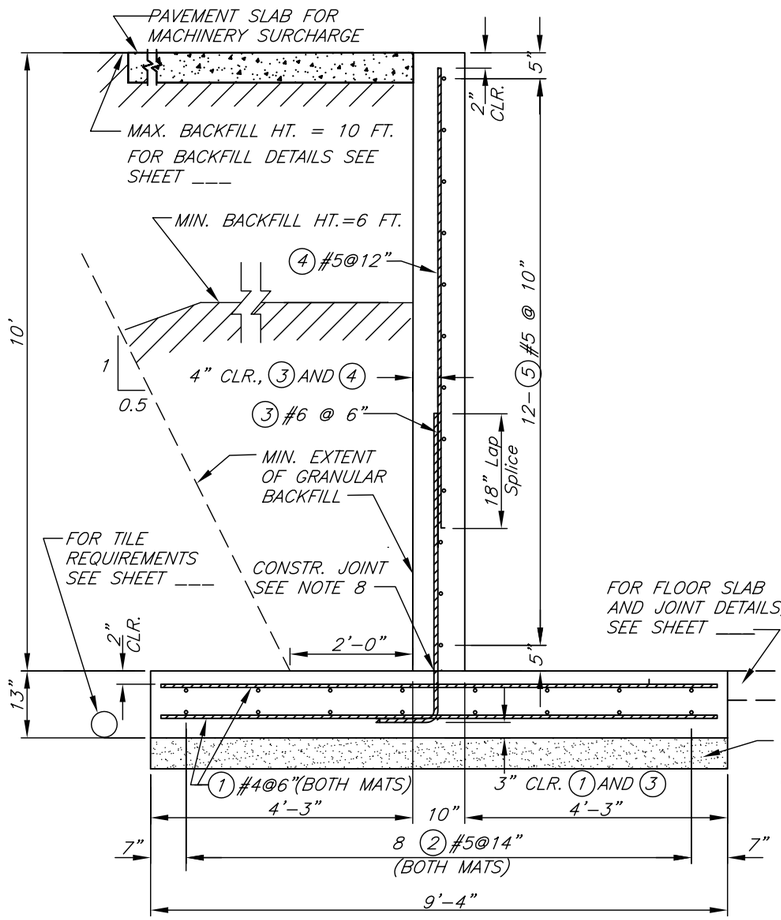

WALL SECTION

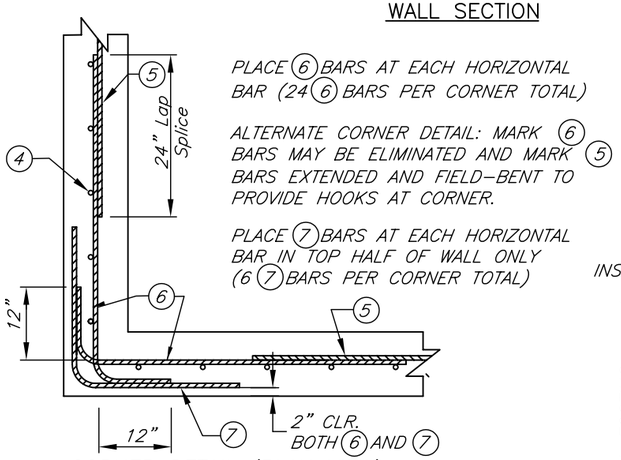

PLACE ⑥ BARS AT EACH HORIZONTAL BAR (24 ⑥ BARS PER CORNER TOTAL)

ALTERNATE CORNER DETAIL: MARK ⑥ BARS MAY BE ELIMINATED AND MARK ⑤ BARS EXTENDED AND FIELD–BENT TO PROVIDE HOOKS AT CORNER.

PLACE ⑦ BARS AT EACH HORIZONTAL BAR IN TOP HALF OF WALL ONLY (6 ⑦ BARS PER CORNER TOTAL)

CORNER DETAIL (PLAN VIEW)
Upper half of wall shown

STANDARD DWG. NO. IA–1696a	
DATE 03/08	SHEET 1 OF 1

STEEL SCHEDULE

MARK	SIZE	QUAN.	TYPE	A	B	C	LENGTH	TOTAL LENGTH
①	#4		STR	---	---	---	8'–11"	
②	#5		STR	---	---	---		
③	#6		2	1'–0"	5'–0"	---	6'–0"	
④	#5		STR	---	---	---	7'–2"	
⑤	#5		STR	---	---	---		
⑥	#5		20	---	1'–0"	4'–0"	5'–0"	
⑦	#4		20	---	2'–0"	2'–0"	4'–0"	
⑧	#4		STR	---	---	---	3'–0"	
							#4 Bars Total Length	
							#5 Bars Total Length	
							#6 Bars Total Length	

STEEL DETAILS

BAR SIZE	INSIDE BEND DIAMETER (D) INCHES	LONGITUDINAL STEEL LAP SPLICE LENGTH, INCHES (MIN.) Wall bars	Footing bars
#4	3	–	–
#5	3–3/4	24	18
#6	4–1/2	–	–

Total length of wall (measured along ℄ wall) = _____ ft.

ESTIMATED QUANTITIES

CONCRETE (0.683 CU.YD./FT OF WALL)=_____ CU.YD.
STEEL #4 BARS (0.668 LB./FT.)=_____ LB.
STEEL #5 BARS (1.043 LB./FT.)=_____ LB.
STEEL #6 BARS (1.502 LB./FT.)=_____ LB.

Steel quantity include splice lengths? Y__ N__

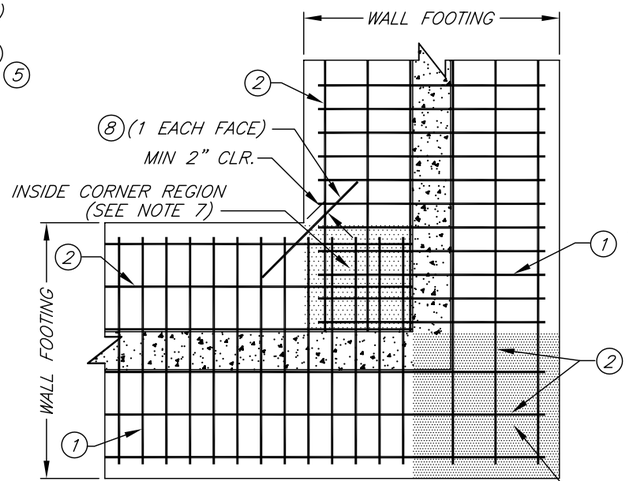

FOOTING SLAB CORNER DETAIL (PLAN VIEW)
Schematic only – not all bars shown

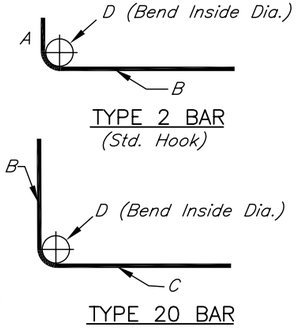

Adapted from Wisconsin drawing WI–594

CONDITIONS OF USE

Allowable backfill height = 6 to 10 ft
Soil backfill type = gravel–sand mix, or coarse sand, with less than 50% fines
Water table below footing
Machinery surcharge allowed on pavement slab
Machinery surcharge load NOT allowed directly on soil for backfill heights greater than 8 ft.
Not designed to support buildings or roofs

MATERIALS

Concrete compressive strength = 4,000 psi
Reinforcing steel shall be Grade 60.
Concrete and reinforcing steel shall meet requirements of Construction Specification IA–31.

WALL DESIGN LOADINGS

Manure load inside = 65 psf/ft EFP (Equivalent Fluid Pressure)
Soil backfill density = 110 pcf
Soil backfill load = 60 psf/ft EFP
Design surcharge load = 45 psf horizontal pressure (modeling machinery on slab)

WALL SLIDING RESTRAINT REQUIREMENTS

Assumptions:
5–inch thick floor slab, factor of safety against sliding 1.5.
Coefficient of friction (soil/concrete) = 0.4 (well–graded, angular gravel/sand base)

Backfill Height, ft.	Min. Floor Slab Length, ft.*
10	132
9	98
8	67
7	40
6	17

** Min. floor slab length for restraint is not required if T–wall forms a tank with opposing wall having approximately the same backfill height.*

GENERAL DESIGN NOTES

1. *Design loadings and soil pressures based upon criteria found in Conservation Practice Standard 313 (Waste Storage Facility).*
2. *Drainage shall be away from the wall.*
3. *Minimum width of backfill against the wall shall be equal to or greater than the backfill height.*
4. *Minimum required subgrade bearing capacity = 2000 psf.*
5. *Mark ② and ⑤ bars shall extend to 2–3 inches from edge of concrete at ends of straight wall sections.*
6. *Mark ③ and ④ bars shall be placed a maximum of 3 inches from wall end or inside face of corner.*
7. *Footing slab reinforcement at corners: for Inside Corner Region (see detail), extend Mark ① (transverse) bars into this region from both sides of corner. Extend Mark ② (longitudinal) bars into Inside Corner to inside face of wall. For Outside Corner Region, discontinue Mark ① bars. Extend Mark ② bars into Outside Corner Region from both sides of corner, to 2–3 inches from edge of slab.*
8. *Construction joint shall be completed as described in Const. Spec. IA–31. Surface of construction joint shall be roughened to approximately 1/4" depth.*
9. *Important: steel location (clear distance from face of wall or slab) must be carefully maintained as shown on the drawings in order for structure to achieve its design load–carrying capacity.*

NOT TO SCALE

Date	07/08
Designed	
Drawn	JGibbs
Checked	
Approved	

10–FT HIGH REINFORCED CONCRETE "T" WALL 6' TO 10' GRANULAR BACKFILL, SURCHARGE ON SLAB 10" WALL THICKNESS

NRCS
Natural Resources Conservation Service
United States Department of Agriculture

File No. IA–1696a.dwg

Drawing No. ____

Sheet of