


FIRE COMPANY CERTIFICATION:
 NAME & TITLE _____
 NATURAL RESOURCES CONSERVATION SERVICE CERTIFICATION:
 NAME & TITLE _____

FREEZE PROTECTION YES ___ NO ___
 1/4" PVC FROM HEAD ASS'Y TO BELOW NORMAL WATER LEVEL. ANNUAL SPACE FILLED WITH INSULATION FOAM. (PRECLUDED OR EXPANDING FOAM) GUARD POSTS - SEE NOTE #1
 YES ___ NO ___

ITEM	MARK	QUAN.	UNIT
6" HYDRANT ASSEMBLY - 45° ELBOW	1	1	EACH
HYDRANT CAP	2	1	EACH
3" PVC STRAINER	3	1	EACH
SCH. 40 PVC 45° ELBOW	4	1	EACH
SCH. 40 PVC PIPE-RISER	5	1	LN. FT.
SCH. 40 PVC PIPE	6	1	LN. FT.
SCH. 40 PVC COUPLINGS	7	1	EACH
UNDER-WATER SUPPORT	8	1	CAN
PVC GLUE	9	1	CAN
PRIMER CLEANER		1	EACH
6" STRAINER CAP		1	EACH

ITEM	SITE DATA	ADRES
POOL- DROUGHT POOL	_____	ADRES
MINIMUM DRAW	_____	FEET
MAXIMUM DRAW	_____	FEET
AVAILABLE WATER AT NORMAL LEVEL	_____	GAL.
AVAILABLE WATER AT DROUGHT LEVEL	_____	GAL.

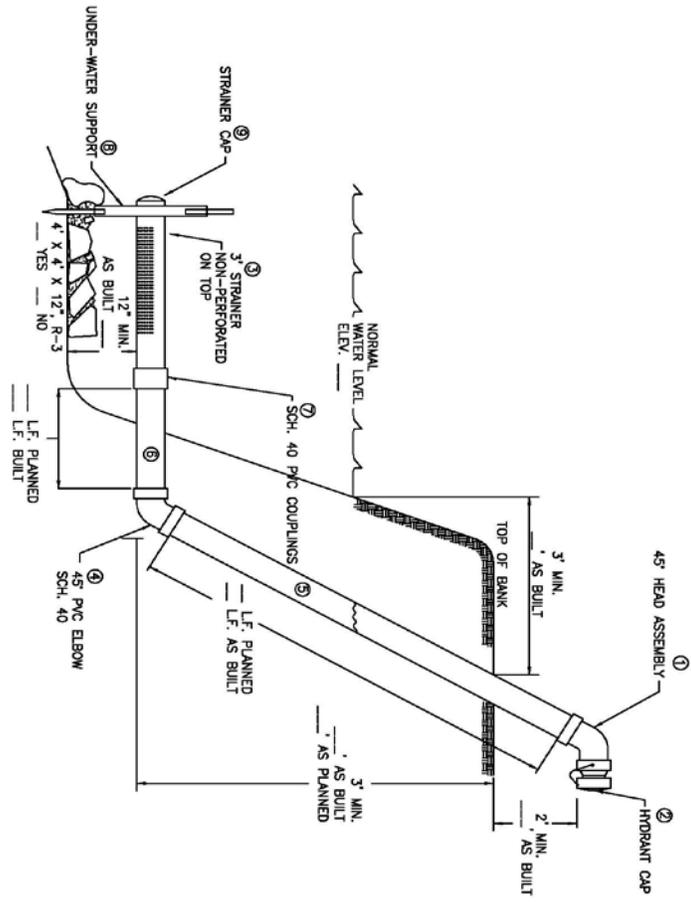

PROFILE
 NOT TO SCALE

NOTES:
 1. FOR GUARD POSTS, IF REQUIRED, SHALL BE CONSTRUCTED FOR LOCAL CONDITIONS.
 2. UNDER-WATER SUPPORT CAN BE COMMERCIAL KIT OR



_____ COUNTY, PENNSYLVANIA
6" DRY HYDRANT - SLOPING

Design
 Drawn
 Check
 Approved