




JOINT E

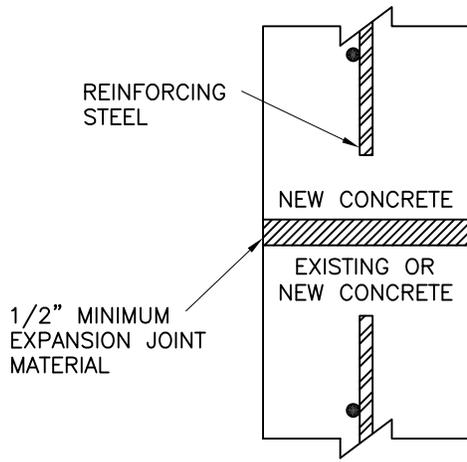


JOINT F

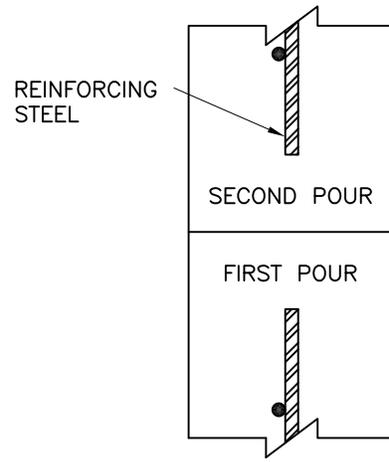

JOINT G

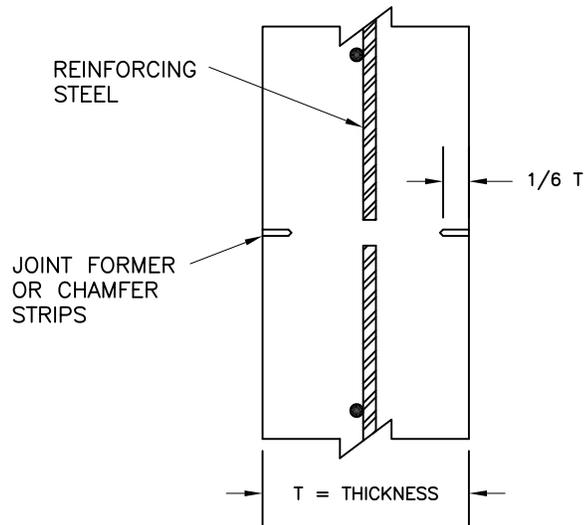

JOINT H

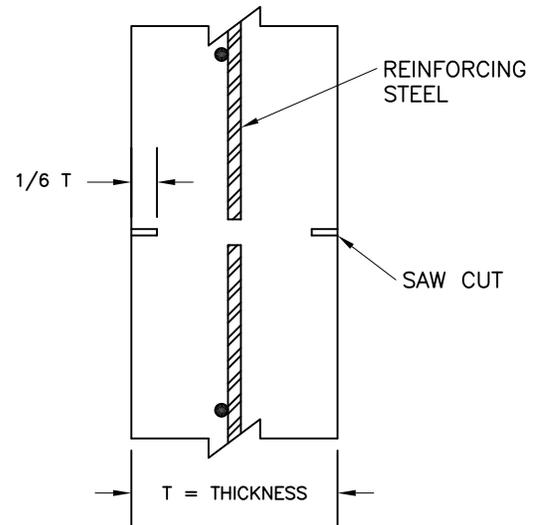

NOTES:

1/3 T JOINT DEPTH ON ONE SIDE IS ACCEPTABLE.
STRIP JOINT FORMERS AFTER CONCRETE SETS.

NOTES:

1/3 T JOINT DEPTH ON ONE SIDE IS ACCEPTABLE.
SAW CUT MUST BE COMPLETED WITHIN 12 HOURS OF CONCRETE PLACEMENT.

CROSS SECTIONS

JOINT _____ ESTIMATED LENGTH _____ LIN. FT.

JOINT _____ ESTIMATED LENGTH _____ LIN. FT.

JOINT _____ ESTIMATED LENGTH _____ LIN. FT.



United States
Department of
Agriculture

Natural Resources
Conservation Service

NON-LIQUID TIGHT WALL JOINTS

CLIENT: _____
COUNTY: _____

Date	_____
Designed	_____
Drawn	_____
Checked	_____
Approved	_____

File Name	WI-508
Date	07/14
Sheet	of