



TOTAL LENGTH OF WALL _____ FT.

CONDITIONS OF USE
 BACKFILL = 0 TO 3 FEET
 NO SURCHARGE
 SOIL EFP = 75

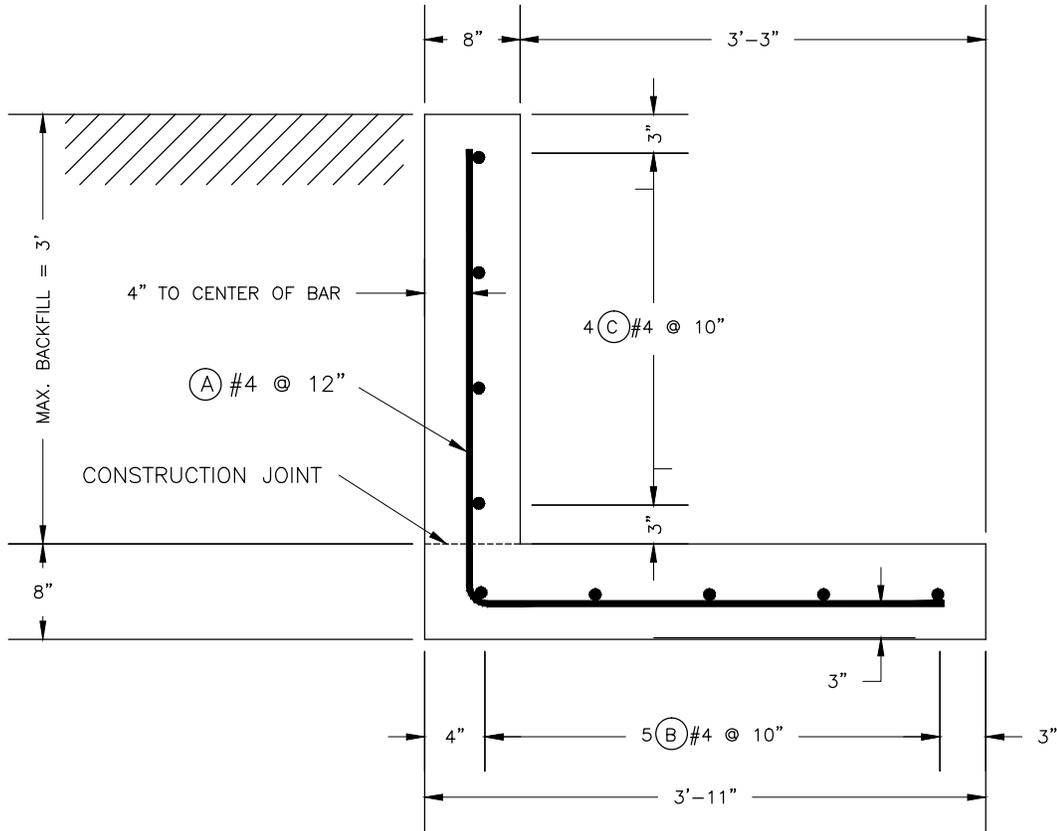

SEE REVERSE SIDE FOR
 ADDITIONAL INFORMATION

STEEL SCHEDULE

ESTIMATED QUANTITIES

MARK	SIZE	QUAN	TYPE	R	S	LENGTH	TOTAL LENGTH
A	4		2	3'-4"	3'-2"	6'-6"	
B	4		STR	----	----		
C	4		STR	----	----		
L	4		2	2'-0"	2'-0"	4'-0"	
#4 BARS, TOTAL LENGTH							

CONCRETE	(0.1708 CU.YDS./LIN.FT.)	_____	CU.YDS.
STEEL #4	(0.668 LBS./FT)	_____	LBS.

- CONCRETE WILL MEET WISCONSIN SPEC 4 REQUIREMENTS.
- SUBSTITUTION OF GRADE 60 BARS IS PERMITTED.
- MINIMUM SPLICE LENGTH FOR MARK (B) AND (C) BARS IS 12"
- STEEL QUANTITY DOES NOT INCLUDE SPLICE LENGTHS.

MARK L BARS NOT SHOWN – SEE WALL CORNER DETAILS ON REVERSE SIDE.

NOTES:

1. CONSTRUCTION JOINT OPTIONS – SEE REVERSE SIDE.
2. DIMENSIONS ARE TO THE REINFORCING BAR SURFACE UNLESS OTHERWISE NOTED.
3. FOR RESTRAINING SLAB REQUIREMENTS – SEE REVERSE SIDE.
4. BACKFILL OF 2 FEET IS RECOMMENDED FOR FROST PROTECTION.

WI-533 Page 1 of 2





3-FOOT L WALL
 8" WALL THICKNESS

CLIENT: _____
 COUNTY: _____

Date _____
 Designed _____
 Drawn _____
 Checked _____
 Approved _____

File Name
 WI-533
 Date
 07/14
 Sheet of

CORNER DETAIL (PLAN VIEW)

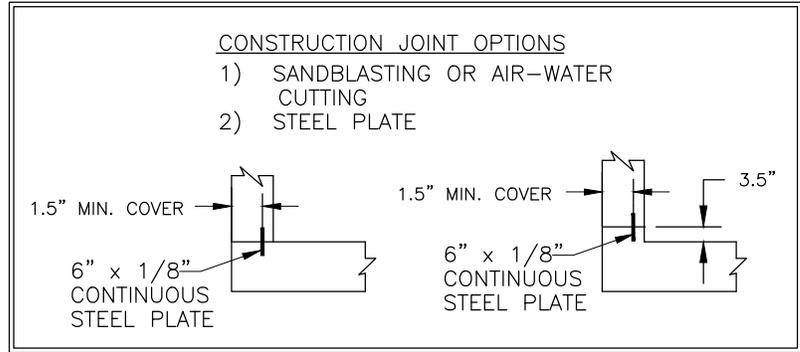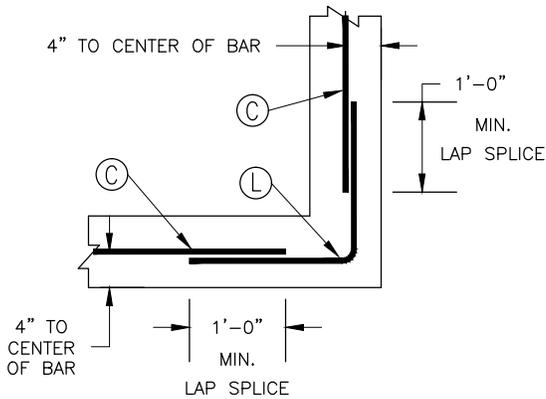

SLAB CORNER DETAILS	SEE WI-571
RESTRAINING SLAB OPTIONS	SEE WI-570

GENERAL DESIGN NOTES:

- DRAINAGE SHALL BE AWAY FROM THE WALL.
- THE MINIMUM WIDTH OF THE BACKFILL AGAINST THE WALL SHALL BE EQUAL TO OR GREATER THAN THE BACKFILL HEIGHT.
- MAXIMUM FOOTING CONTACT PRESSURE IS 655 psf/ft.

DESIGN STRENGTHS: WORKING STRESS DESIGN

- CONCRETE $f'_c = 3,500$ psi
- STEEL $f_s = 20,000$ psi (GRADE 40)
- $f_c = 1,400$ psi

WALL DESIGN LOADING: 313 STANDARD – LATERAL EARTH PRESSURE VALUES, SEE SECTION IV OF THE FIELD OFFICE TECHNICAL GUIDE.

- MANURE LOAD INSIDE = 65 psf/ft.
- SOIL BACKFILL LOAD OUTSIDE = 75 psf/ft.
- NO SURCHARGE LOAD
- SOIL BACKFILL DENSITY = 110 pcf.

WALL RESTRAINT REQUIREMENTS:

- 5" THICK SLAB, SAFETY FACTOR AGAINST SLIDING 1.5 MIN.

<u>BACKFILL HEIGHT (OUTSIDE LOAD)</u>	<u>SLAB LENGTH NO INSIDE LOAD</u>	<u>SLAB LENGTH FULL INSIDE LOAD</u>
3 FEET	14 FEET	NO SLAB
2 FEET	2 FEET	NO SLAB
1 FOOT	NO SLAB	NO SLAB
0 FEET	NO SLAB	NO SLAB

THIS STANDARDIZED DESIGN MUST BE ADAPTED TO THE SPECIFIC SITE. IT WAS DEVELOPED IN COOPERATION WITH THE WISCONSIN DEPARTMENT OF AGRICULTURAL, TRADE AND CONSUMER PROTECTION. THE DESIGN FOLDER IS FILED AT THE NRCS STATE OFFICE, 8030 EXCELSIOR DRIVE, SUITE 200 MADISON, WI 53717-2906