


1. CONCRETE SURFACE

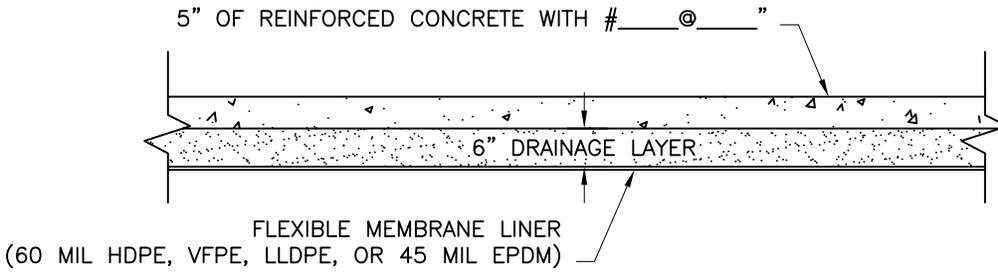


2. FLEXIBLE PAVEMENT SURFACE

4" (IN TWO LIFTS) WISCONSIN DOT E-0.3 HOT MIX ASPHALT
OVER 9" CRUSHED STONE SUBBASE FOR SUBGRADE SOILS
CLASSIFIED AS SP, GP, SW, AND GW


FOR ALL OTHER SUBGRADE SOILS
EXCEPT ORGANIC SOILS, USE A
4" (IN TWO LIFTS) WISCONSIN DOT E-0.3 HOT MIX ASPHALT
OVER 13" CRUSHED STONE SUBBASE

CRUSHED STONE: 100% PASSING THE
3/4-INCH SIEVE AND 10% MAXIMUM
PASSING THE NO. 200 SIEVE.

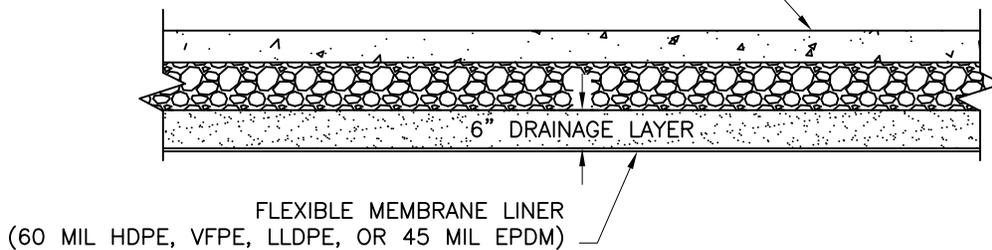

3. MACADAM SURFACE

CRUSHED STONE: 100% PASSING THE
3/4-INCH SIEVE AND 10% MAXIMUM
PASSING THE NO. 200 SIEVE.

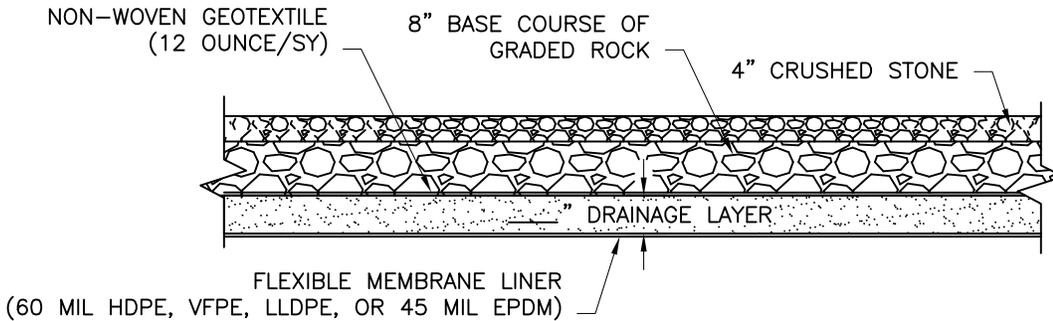

NOTES:

- PREPARE THE SUBGRADE ACCORDING TO WISCONSIN CONSTRUCTION SPECIFICATION 202 OR 203.
- THE DRAINAGE LAYER MUST CONSIST OF ROUNDED MATERIAL WITH $\leq 5\%$ PASSING THE #200 SIEVE, AND HAVE A DIAMETER $\leq \frac{3}{16}$ " (CLEAN SAND). THIS IS REQUIRED FOR LINER PROTECTION.
- IF THE BASE COURSE CONTAINS AGGREGATE LARGER THAN 4 INCH DIAMETER, THE DRAINAGE LAYER SHALL BE TWICE THE DEPTH OF THE LARGEST AGGREGATE IN THE BASE COURSE.



United States
Department of
Agriculture

Natural Resources
Conservation Service

FEED STORAGE AREA
FLEXIBLE MEMBRANE
COLLECTION SYSTEM

CLIENT: _____
COUNTY: _____

Date _____
Designed _____
Drawn _____
Checked _____
Approved _____

File Name
WI-904
Date
08/14
Sheet of _____