



TOTAL LENGTH OF CURB _____ FT.

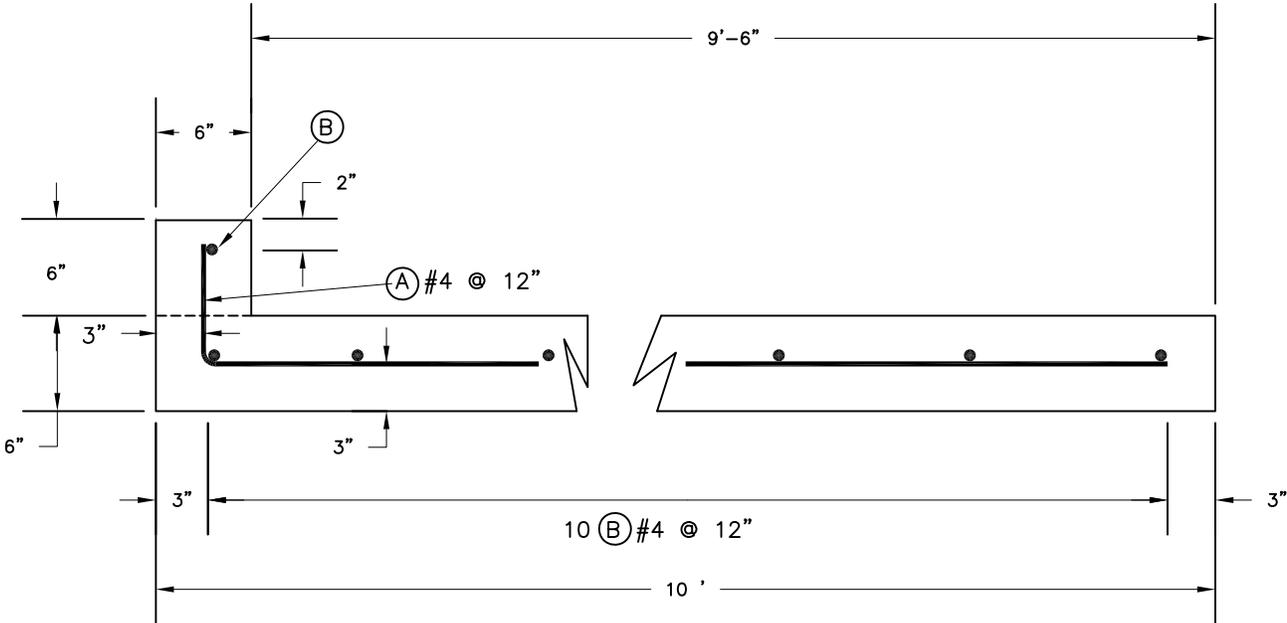

CORNER DETAIL (PLAN VIEW)

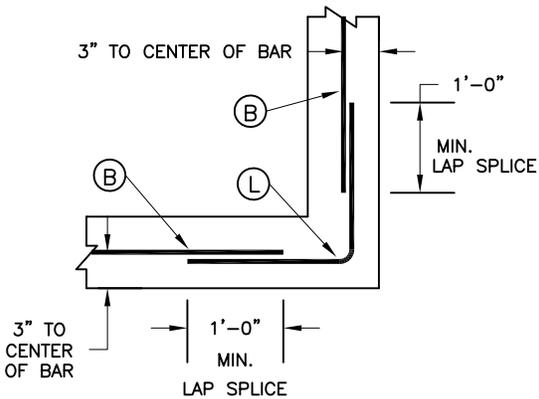


CONSTRUCTION JOINT OPTIONS

1. IF SLAB AND CURB ARE POURED SEPARATELY, THE SLAB SURFACE MUST BE THOROUGHLY CLEANED WITH WATER AND A WIRE BRUSH. THE SURFACE OF THE JOINT SHALL BE KEPT MOIST FOR AT LEAST 1 HOUR PRIOR TO PLACEMENT OF NEW CONCRETE.
2. THE SLAB AND CURB MAY BE POURED AT THE SAME TIME ELIMINATING THE NEED FOR A CONSTRUCTION JOINT.

STEEL SCHEDULE

MARK	SIZE	QUAN	TYPE	R	S	LENGTH	TOTAL LENGTH
A	4		2	7"	9'-6"	10'-1"	
B	4		STR	---	---		
L	4		2	2'-0"	2'-0"	4'-0"	



ESTIMATED QUANTITIES

CONCRETE (0.1944 CU. YDS./LIN. FT.) _____ CU.YDS.
 STEEL #4 (0.668 LBS./FT) _____ LBS.

DESIGN STRENGTHS:

- CONCRETE $f'_c = 3,500$ psi
 $f_c = 1,400$ psi
- STEEL $f = 20,000$ psi (GRADE 40)



United States Department of Agriculture

Natural Resources Conservation Service

6" CURB

CLIENT: _____
 COUNTY: _____

Date _____
 Designed _____
 Drawn _____
 Checked _____
 Approved _____

File Name
 WI-912D
 Date
 08/14
 Sheet of _____