



TOTAL LENGTH OF WALL _____ FT.
 BACKFILL NOT ALLOWED.

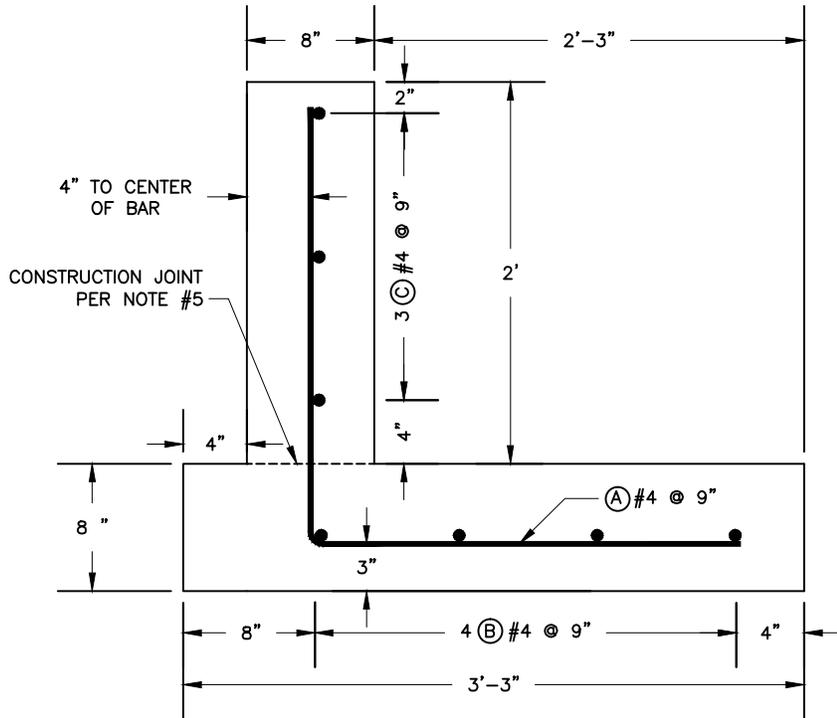

3.5" CLEARANCE BETWEEN NOTCHES AND ALL REBAR

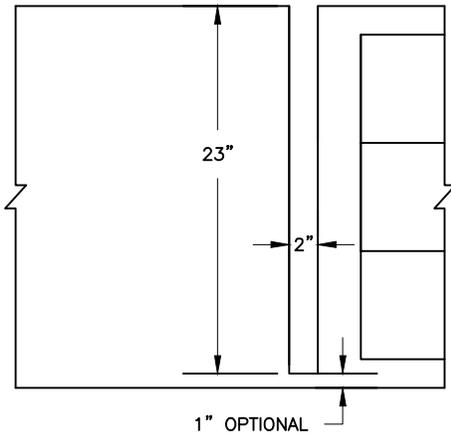

NOTCH DETAILS

NOTES:

1. CONCRETE WILL MEET WISCONSIN SPEC 4 REQUIREMENTS.
2. GRADE 40 OR 60 BARS ARE PERMITTED.
3. MINIMUM SPLICE LENGTH FOR MARK (B) IS 12"
4. STEEL QUANTITY DOES NOT INCLUDE SPLICE LENGTHS.
5. THE SLAB SURFACE MUST BE THOROUGHLY CLEANED WITH WATER AND A WIRE BRUSH. THE SURFACE OF THE JOINT SHALL BE KEPT MOIST FOR AT LEAST ONE HOUR PRIOR TO PLACEMENT OF NEW CONCRETE.

ALL VERTICAL AND HORIZONTAL REBAR NOT SHOWN. SEE NOTCH AND STEEL LAYOUT DETAIL ON BACK

STEEL SCHEDULE

MARK	SIZE	QUAN	TYPE	R	S	LENGTH	TOTAL LENGTH
A	4		2	2'-3"	2'-3"	4'-6"	
B	4		STR	----	----		
C	4		STR	----	----		
#4 BARS, TOTAL LENGTH							



TYPE 2 BAR

ESTIMATED QUANTITIES

CONCRETE (0.130 CU.YDS./LIN.FT.)	_____ CU.YDS.
STEEL #4 (0.668 LBS./FT)	_____ LBS.

BASED ON WI-523, 6/07

WI-920 Page 1 of 2




2-FOOT SPREADER WALL
 8" WALL THICKNESS

CLIENT: _____
 COUNTY: _____

Date _____
 Designed _____
 Drawn _____
 Checked _____
 Approved _____

File Name
 WI-920
 Date
 08/14
 Sheet of

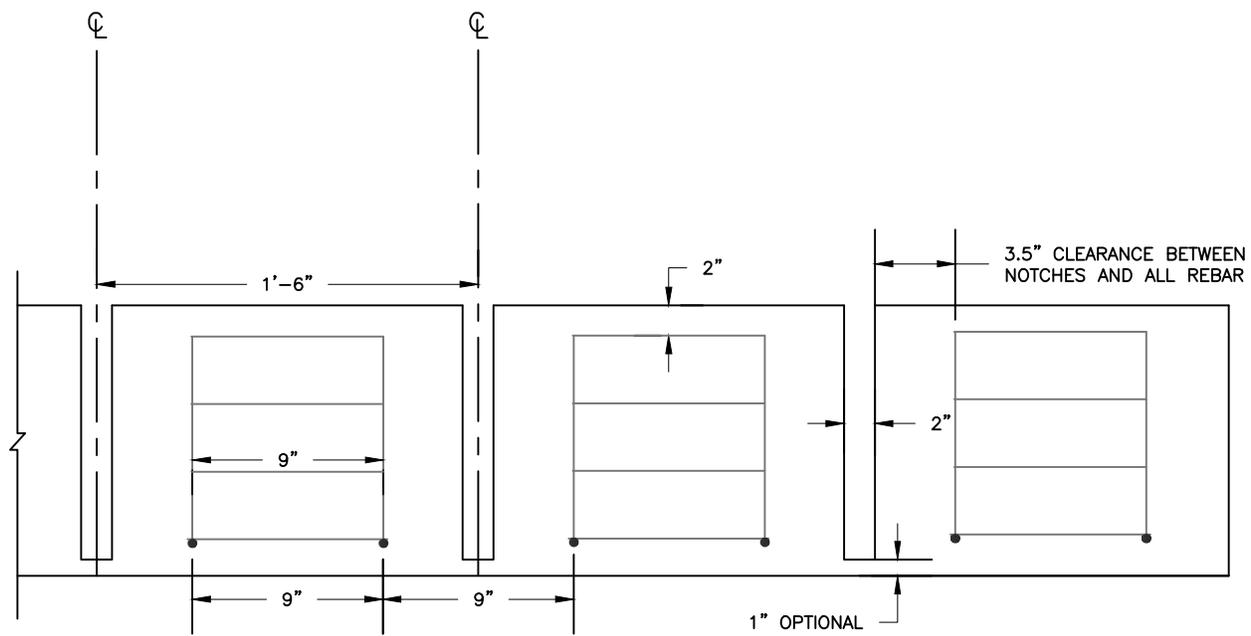

NOTCH AND STEEL LAYOUT DETAIL