


SECTION  
SCALE 3/8" = 1'

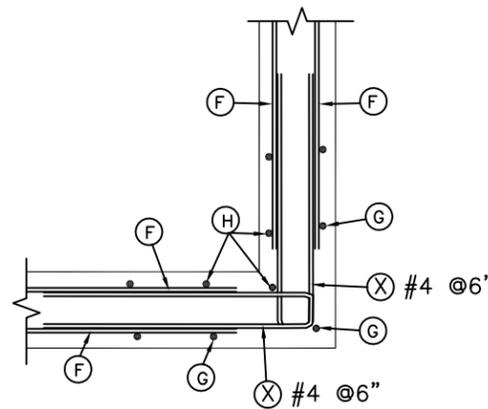


WALL CORNER DETAIL

NOT TO SCALE

NOTE: All bars spaced 12" on center except where noted.

- (A) - 1 bar per corner
- (B) - 1 bar per corner
- (C) - 1 bar per corner
- (H) - 1 bar per corner
- (X) - 38 bars per corner
- (Z) - 16 bars per corner

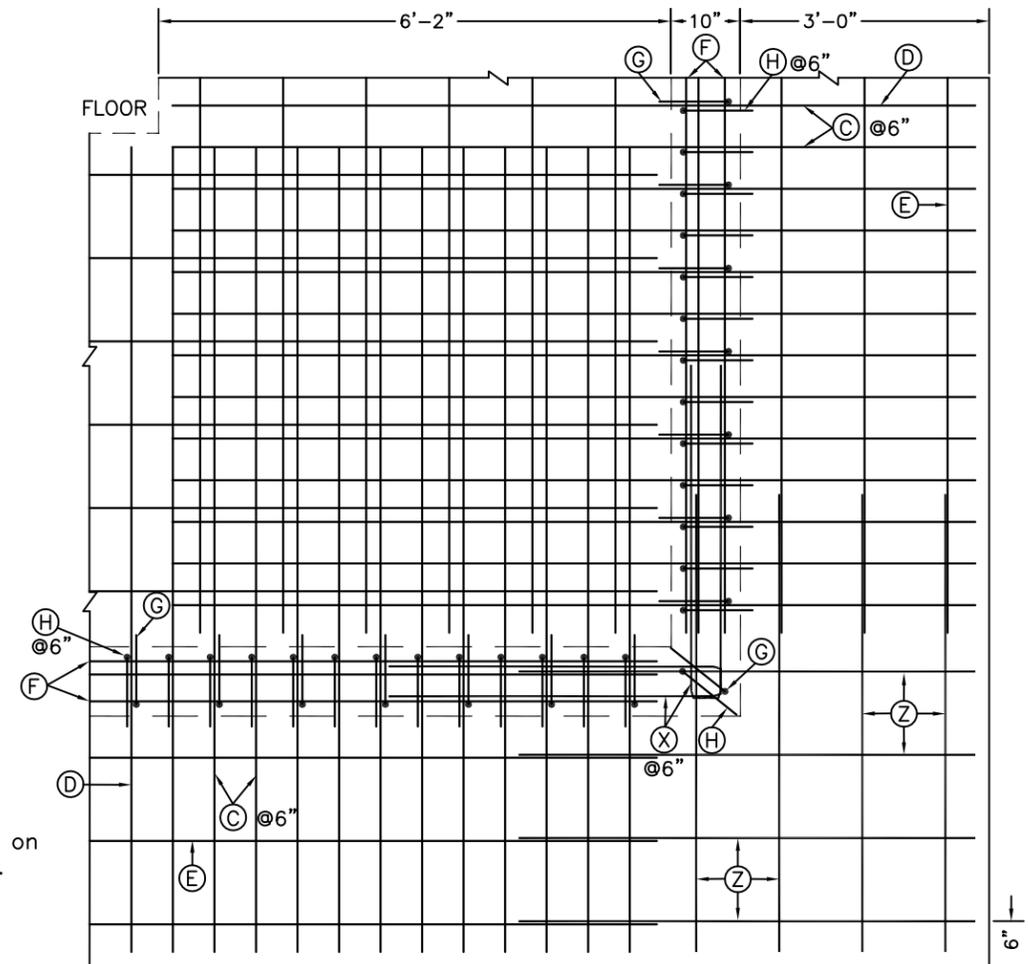

CORNER DETAIL (PLAN VIEW)

NOT TO SCALE


STEEL SCHEDULE

MARK	SIZE	QUANTITY	TYPE	a	b	LENGTH	TOTAL LENGTH
A	4		Straight	-	-	7'-0"	
B	4		Straight	-	-	6'-6"	
C	5		Straight	-	-	9'-8"	
D	4		Straight	-	-	9'-8"	
E	4		Straight				
F	5		Straight				
G	5	21		5'-3"	0'-10"	6'-1"	
H	5	21		5'-9"	0'-10"	6'-7"	
X	4	22		4'-0"	0'-4"	8'-4"	
Z	4		Straight			5'-6"	

#4 BARS, TOTAL LENGTH = \_\_\_\_\_ X 0.668 LBS/FT. = \_\_\_\_\_LBS  
 #5 BARS, TOTAL LENGTH = \_\_\_\_\_ X 1.043 LBS/FT. = \_\_\_\_\_LBS

TOTAL REBAR = \_\_\_\_\_ LBS

CONCRETE = 0.679 CY/FT. OF WALL LENGTH ESTIMATED TOTAL = \_\_\_\_\_CY



CONSTRUCTION JOINT DETAIL

NOT TO SCALE



'PE 22 BAR TYPE 21 BAR

WALL DESIGN LOADING

- \* MANURE LOADING = 65 pcf
- \* BACKFILL: GRANULAR, NON-COHESIVE
- \* DENSITY = 120 pcf;  $\phi = 30^\circ$
- \* SURCHARGE = 2' OF BACKFILL EQUIVALENT (120 psf EFP REPRESENTING MACHINERY LOAD ON SOIL)

CONSTRUCTION

- \* CONTRACTION JOINTS SHALL BE PLACED IN WALL AT A MAXIMUM SPACING OF 150'.
- \* EXPANSION JOINTS IN THE FLOOR SLABS SHALL BE A MAXIMUM OF 80', THE SUBBASE MATERIAL UNDER THE SLAB SHALL BE SAND, OR AT LEAST 2" OF SAND OVER CRUSHED STONE OR GRAVEL. SEE PROJECT DRAWINGS AND SPECS FOR ADDITIONAL SUBBASE REQUIREMENTS.
- \* UNLESS OTHERWISE SHOWN, PROVIDE A MINIMUM OF 2" OF CONCRETE COVER OVER ALL STEEL.
- \* ALL CONTRACTION AND EXPANSION JOINTS SHALL HAVE TYPE B WATERSTOPS.
- \* DRAINAGE SHALL BE DIRECTED AWAY FROM THE WALL.
- \* THE TOP WIDTH OF THE BACKFILL AROUND THE WALL SHALL BE AT LEAST 2 TIMES THE BACKFILL HEIGHT.

CONDITIONS OF USE

- \* STANDARD DRAWING - DESIGNER MUST ENSURE THE APPLICATION OF THIS DRAWING MEETS THE ASSUMPTIONS OF THE DESIGN AS STATED.
- \* BACKFILL HEIGHT = 0' TO 6'.
- \* FOOTING MUST BE RESTRAINED WITH A FLOOR SLAB.
- \* DRAINAGE CONDITION: FULL DRAINAGE, EITHER BY COARSE WELL DRAINED BACKFILL OR A DRAINAGE SYSTEM.
- \* MINIMUM SUBGRADE BEARING CAPACITY = 2,000 psf
- \* CONCRETE STRENGTH = 4,000 psi REBAR = GRADE 60

WASTE STORAGE FACILITY	
10' HIGH "TEE" WALL	
PARTIAL BACKFILL (0'-0" TO 6'-0")	
STANDARD DWG. NO. MA-WSF-07	
DATE Sept. 2009	SHEET 1 OF 1

MINIMUM LAP SPLICE  
 #4 bars = 1'-8"  
 #5 bars = 2'-1"

STANDARD DRAWING  
 10' HIGH "TEE" WALL  
 PARTIAL BACKFILL (0'-0" TO 6'-0")  
 WASTE STORAGE FACILITY

Date \_\_\_\_\_  
 Designed \_\_\_\_\_  
 Drawn \_\_\_\_\_  
 Checked \_\_\_\_\_  
 Approved \_\_\_\_\_



Project Name \_\_\_\_\_  
 Drawing Name MA-WSF-07  
 Sheet \_\_\_\_\_ of \_\_\_\_\_