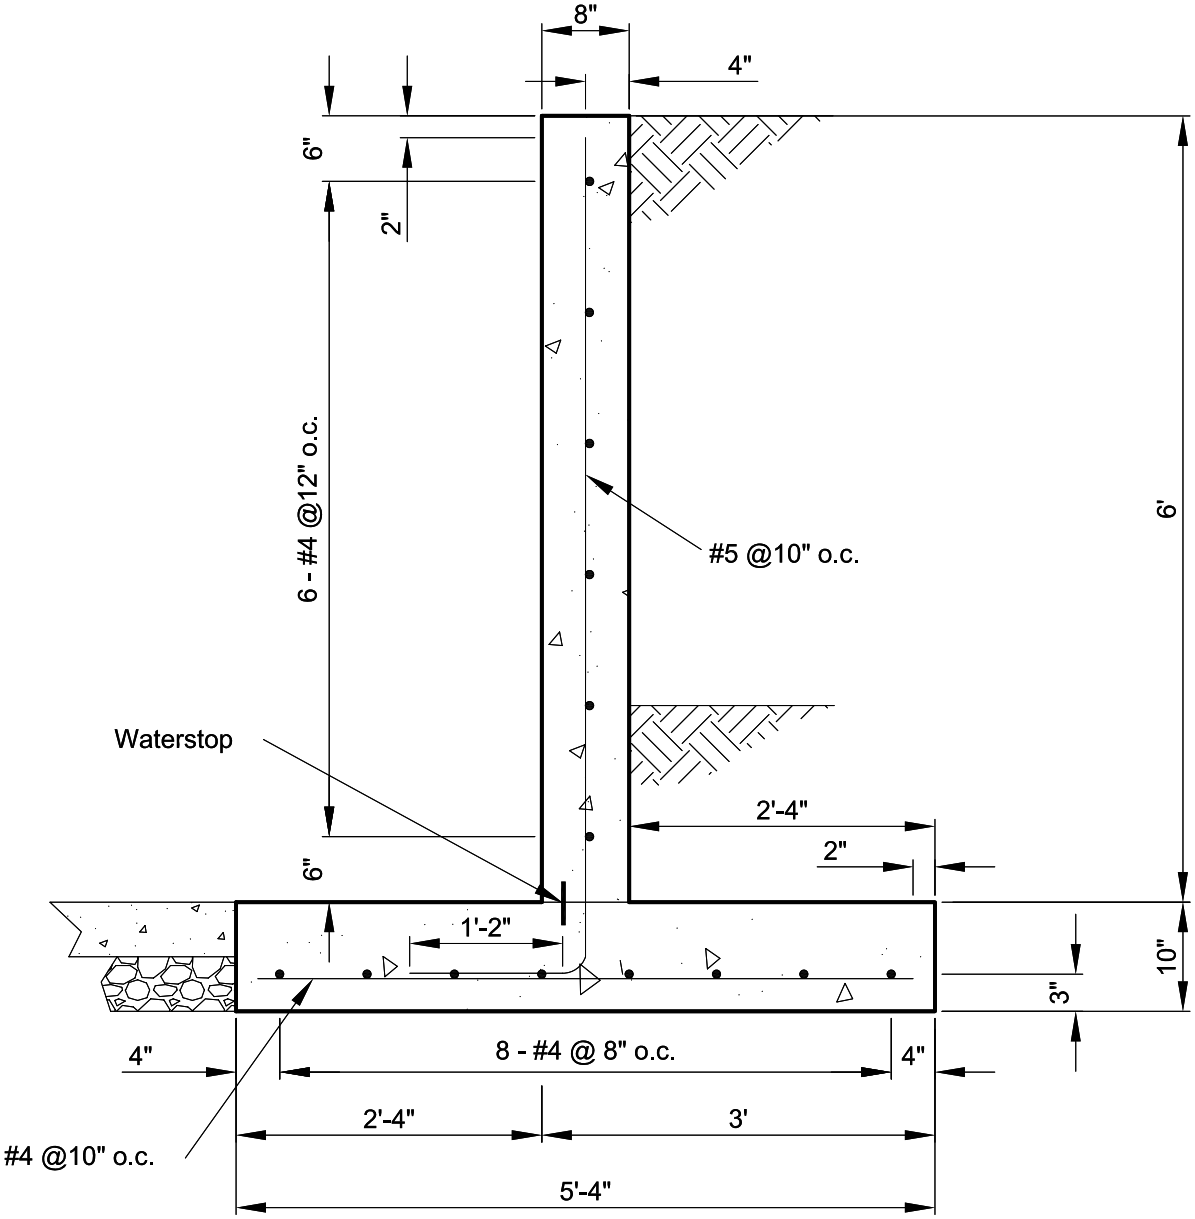

6' RETAINING WALL

CW-6.6.1
NTS

Notes:
1) 4000 psi concrete
2) Grade 60 steel
3) Maximum backfill top of wall (6')
4) Minimum backfill 1.5'
5) Concrete slab must be placed before wall is backfilled
6) Maximum surcharge 100 PSF

NRCS	U.S. Department of Agriculture Natural Resources Conservation Service Maryland	Drawing: CW-6.6.1 Issue: 3/04