


NOT TO SCALE

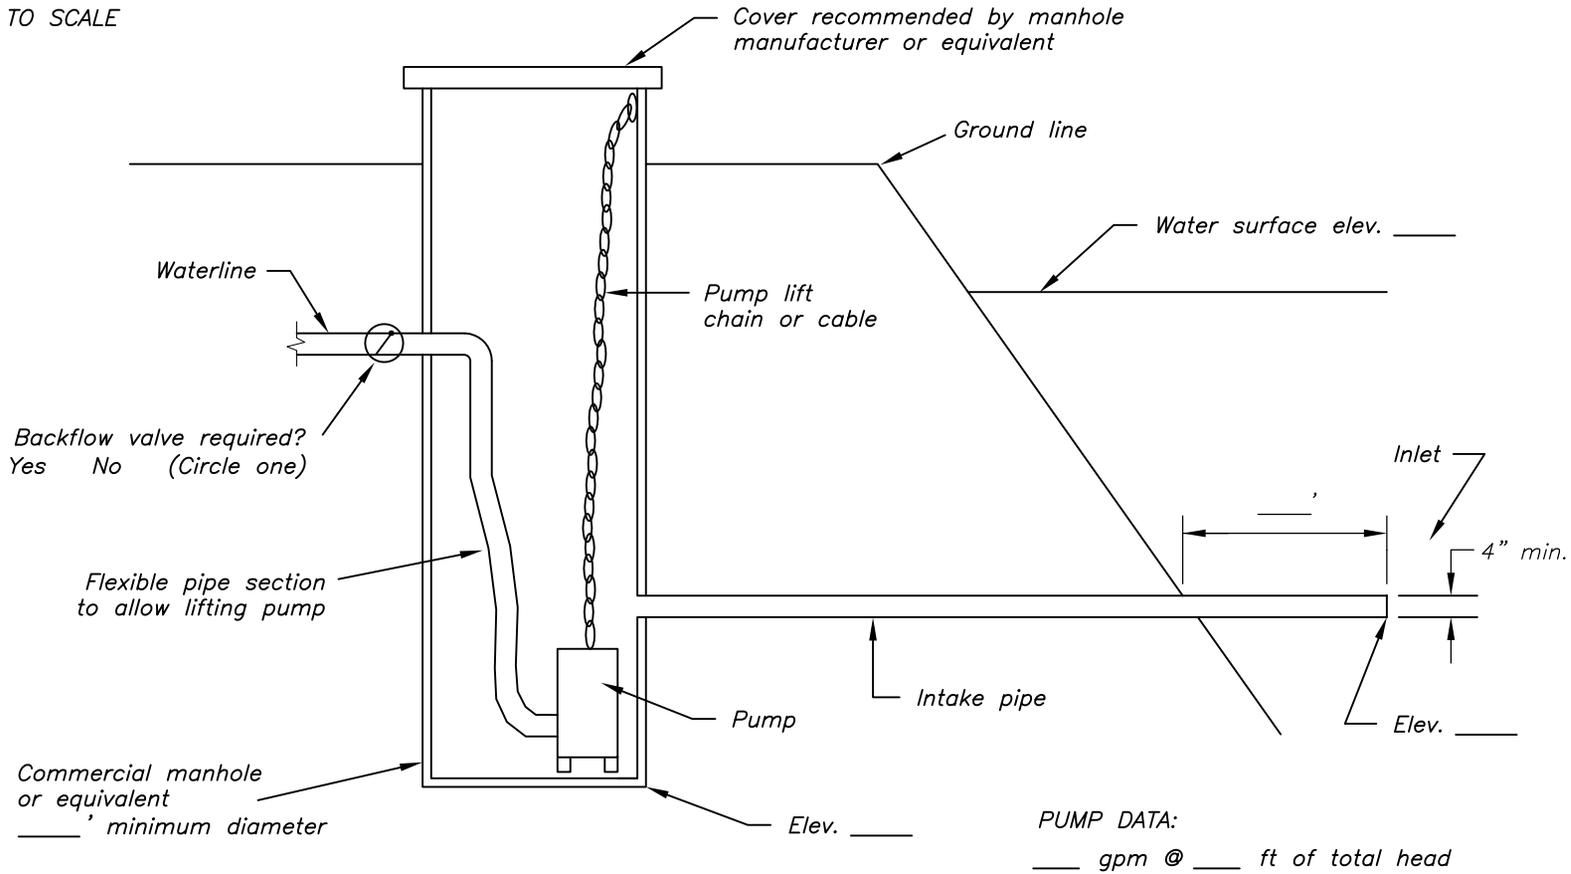

**NOTES:**

1. Intake pipe and manhole to be backfilled adequately to prevent external seepage.
2. The chain or cable shall be adequate to lift the pump without personnel entering the manhole.
3. Electrical wiring must comply with local codes and manufacturers requirements. Electrical plug in to be located outside of manhole so that all electricity can be disconnected prior to pump service.
4. Waterline must be protected from freezing and damage from livestock or equipment.

DRAFT

NOT FOR  
CONSTRUCTION

Date	
Designed	
Drawn	
Checked	
Approved	

RESERVOIR PUMP INTAKE



File Name
Drawing Name <b>29-L-73</b>
Sheet of