


NOT TO SCALE

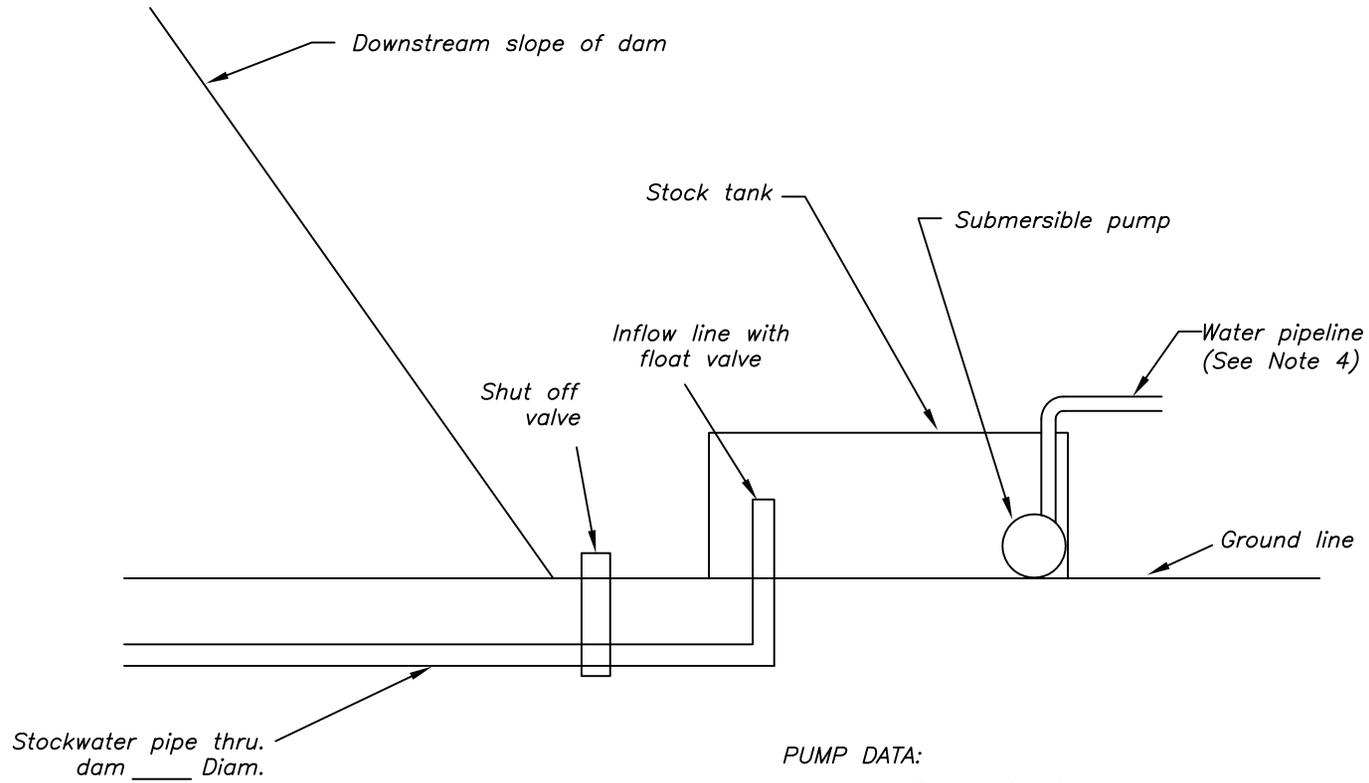

PUMP DATA:
 ___ gpm @ ___ ft of total head

NOTES:

1. Stockwater system to conform to Missouri Standard Drawing _____.
2. A chain or cable shall be provided to permit pump to be removed without personnel entering the tank.
3. Electrical wiring must comply with local codes and manufacturers requirements. Electrical plug to be located outside of tank to permit electricity to be shut off prior to pump service.
4. Waterline must be protected from freezing and damage from livestock or equipment.

Date	_____
Designed	_____
Drawn	_____
Checked	_____
Approved	_____

DOWNSTREAM SUBMERSIBLE
 PUMP DETAILS



DRAFT

NOT FOR
CONSTRUCTION

File Name	_____
Drawing Name	29-L-74
Sheet	of _____