


NOT TO SCALE

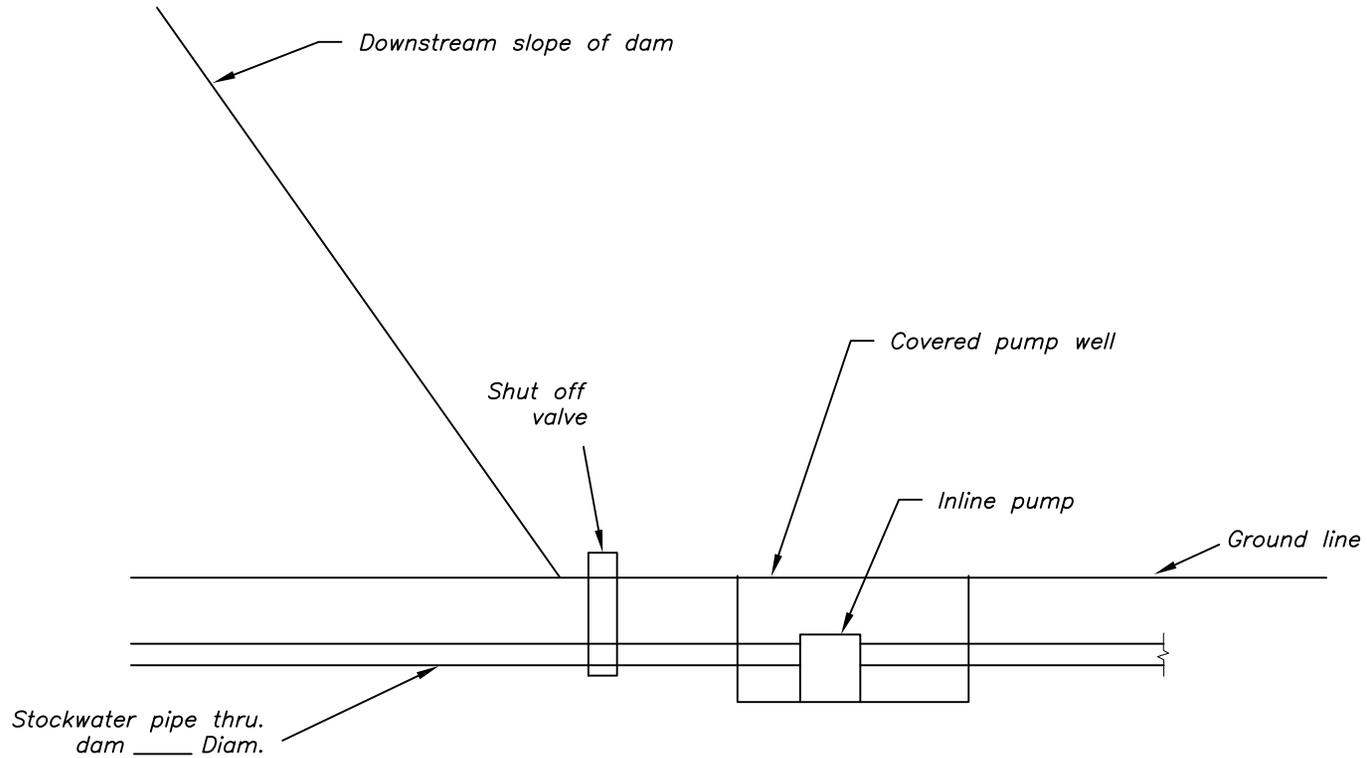

PUMP DATA:  
 \_\_\_ gpm @ \_\_\_ ft of total head

**NOTES:**

1. Stockwater system to conform to Missouri Standard Drawing \_\_\_\_\_
2. A chain or cable shall be provided to permit pump to be removed without personnel entering the tank.
3. Electrical wiring must comply with local codes and manufacturers requirements. Electrical plug to be located outside of tank to permit electricity to be shut off prior to pump service.
4. Waterline must be protected from freezing and damage from livestock and equipment.
5. Pump well shall be structurally sound, reasonably dry and shall not present a hazard for people or livestock falling into.

DRAFT

NOT FOR  
CONSTRUCTION

Date \_\_\_\_\_  
 Designed \_\_\_\_\_  
 Drawn \_\_\_\_\_  
 Checked \_\_\_\_\_  
 Approved \_\_\_\_\_

**DOWNSTREAM INLINE  
SUBMERSIBLE PUMP DETAILS**



File Name \_\_\_\_\_

Drawing Name  
**29-L-75**

Sheet \_\_\_\_\_ of \_\_\_\_\_