


NOT TO SCALE

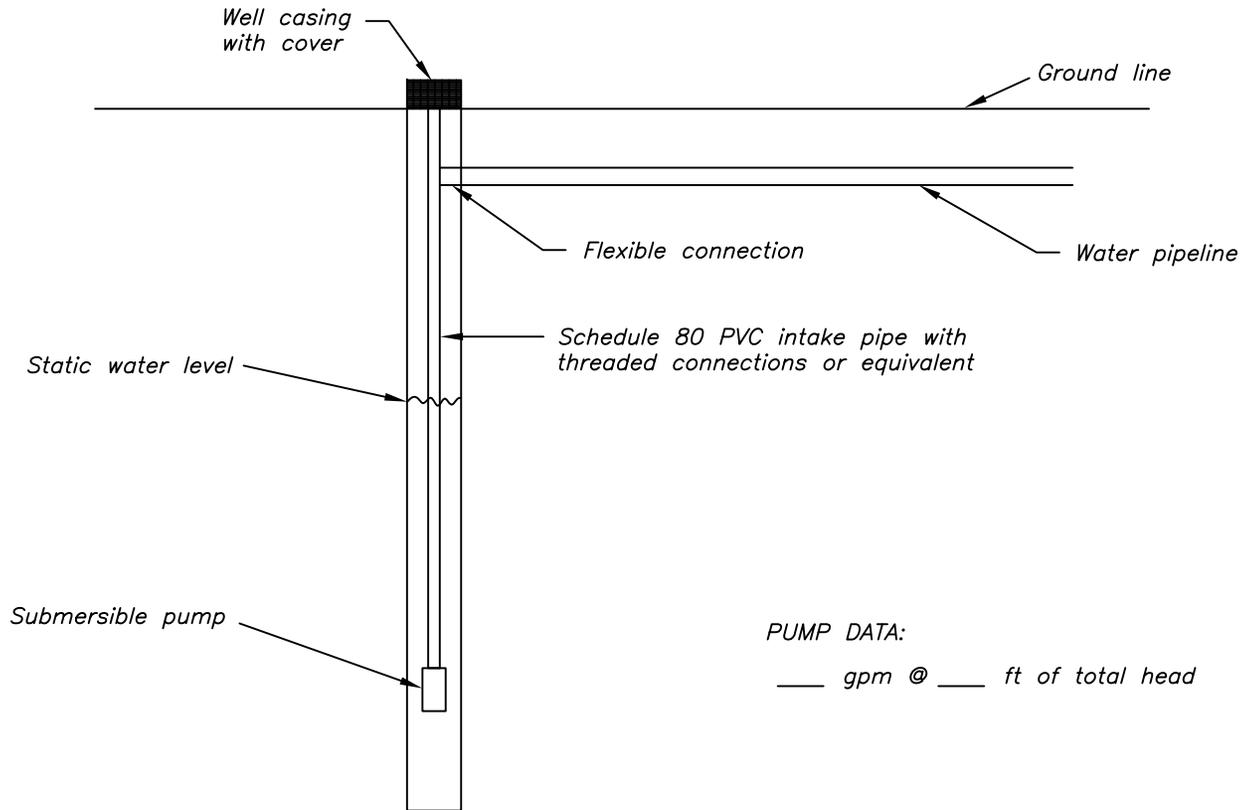

PUMP DATA:

___ gpm @ ___ ft of total head

NOTES:

1. It would be advisable for well and pump to be installed by a licensed well driller.
2. Pump may be hung from polyethylene intake pipe if corrosion resistant chain or cable is used to support pump.
3. Electrical wiring must comply with local codes and manufacturers requirements. Electrical plug to be located outside of tank to permit electricity to be shut off prior to pump service.
4. Waterline must be protected from freezing and damage from livestock or equipment.

Date _____

Designed _____

Drawn _____

Checked _____

Approved _____

WELL DETAILS



DRAFT

NOT FOR CONSTRUCTION

File Name

Drawing Name
29-L-76

Sheet of