


TOP VIEW

NOTES:

1. Weld between box inlet and conduit pipe shall be watertight and covered with two coats of zinc-oxide paint.
2. Reinforcing steel shall be 1/2" diameter spaced at 12" centers both ways, imbedded in concrete a minimum of 3".
3. Minimum gage of pipe & anti-vortex device shall be _____.
4. Direction of corrugations on anti-vortex shall be perpendicular to angle iron.
5. The end plate shall be measured from the valley of the corrugations.
7. For further details see Missouri Construction Specification 378, Pipe Spillway.

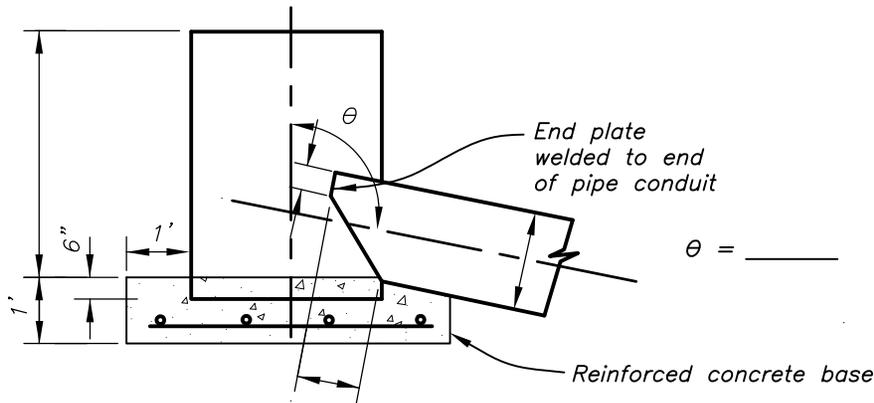

SECTION ALONG C OF INLET

DRAFT
NOT FOR
CONSTRUCTION

Date	_____
Designed	_____
Drawn	_____
Checked	_____
Approved	_____

**DETAILS OF CMP CANOPY INLET
SPILLWAY W/BOX INLET**



File Name	_____
Drawing Name	29-L-114

Sheet of _____