


PARTIAL END VIEW

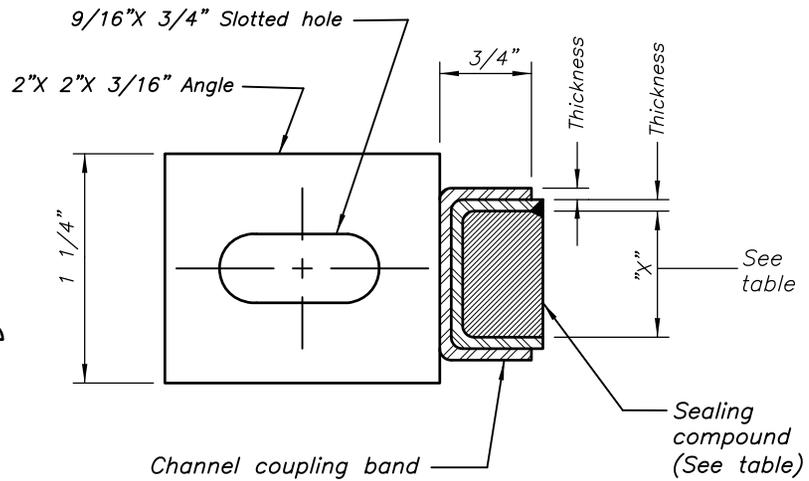


SECTION B - B


TABLE OF NOMINAL DIMENSIONS

Channel Thickness	Dimension "X"	Corrugated steel Pipe Thickness
0.079	3/4"	0.109" or lighter
0.109"	1"	0.138" or lighter

- NOTES:
1. Sealing compound shall be a fiber asphaltic compound or equivalent.
 2. Pipe coatings damaged during rerolling pipe ends shall be repaired with Trumbull 5x mastic or equivalent.

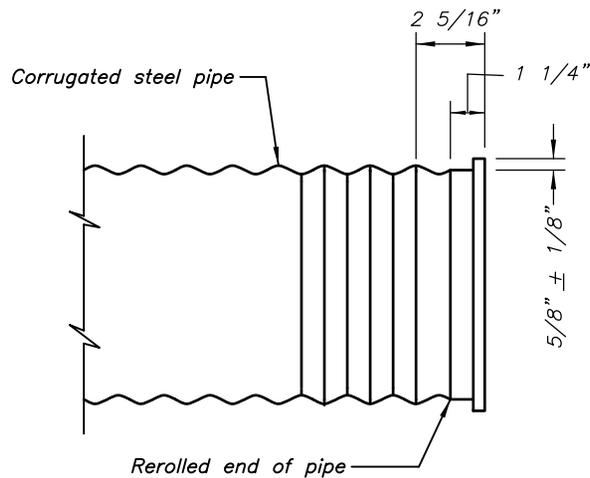

PIPE DETAIL

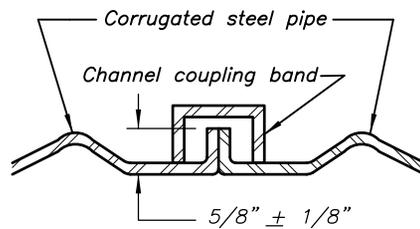

SECTION A - A

NOTE: Sealing compound not shown

DRAFT

NOT FOR CONSTRUCTION

Date _____

Designed _____

Drawn _____

Checked _____

Approved _____

DETAILS OF TWO PIECE CHANNEL COUPLING BAND

United States Department of Agriculture
Natural Resources Conservation Service



File Name _____

Drawing Name
29-L-223

Sheet of _____