


NOT TO SCALE

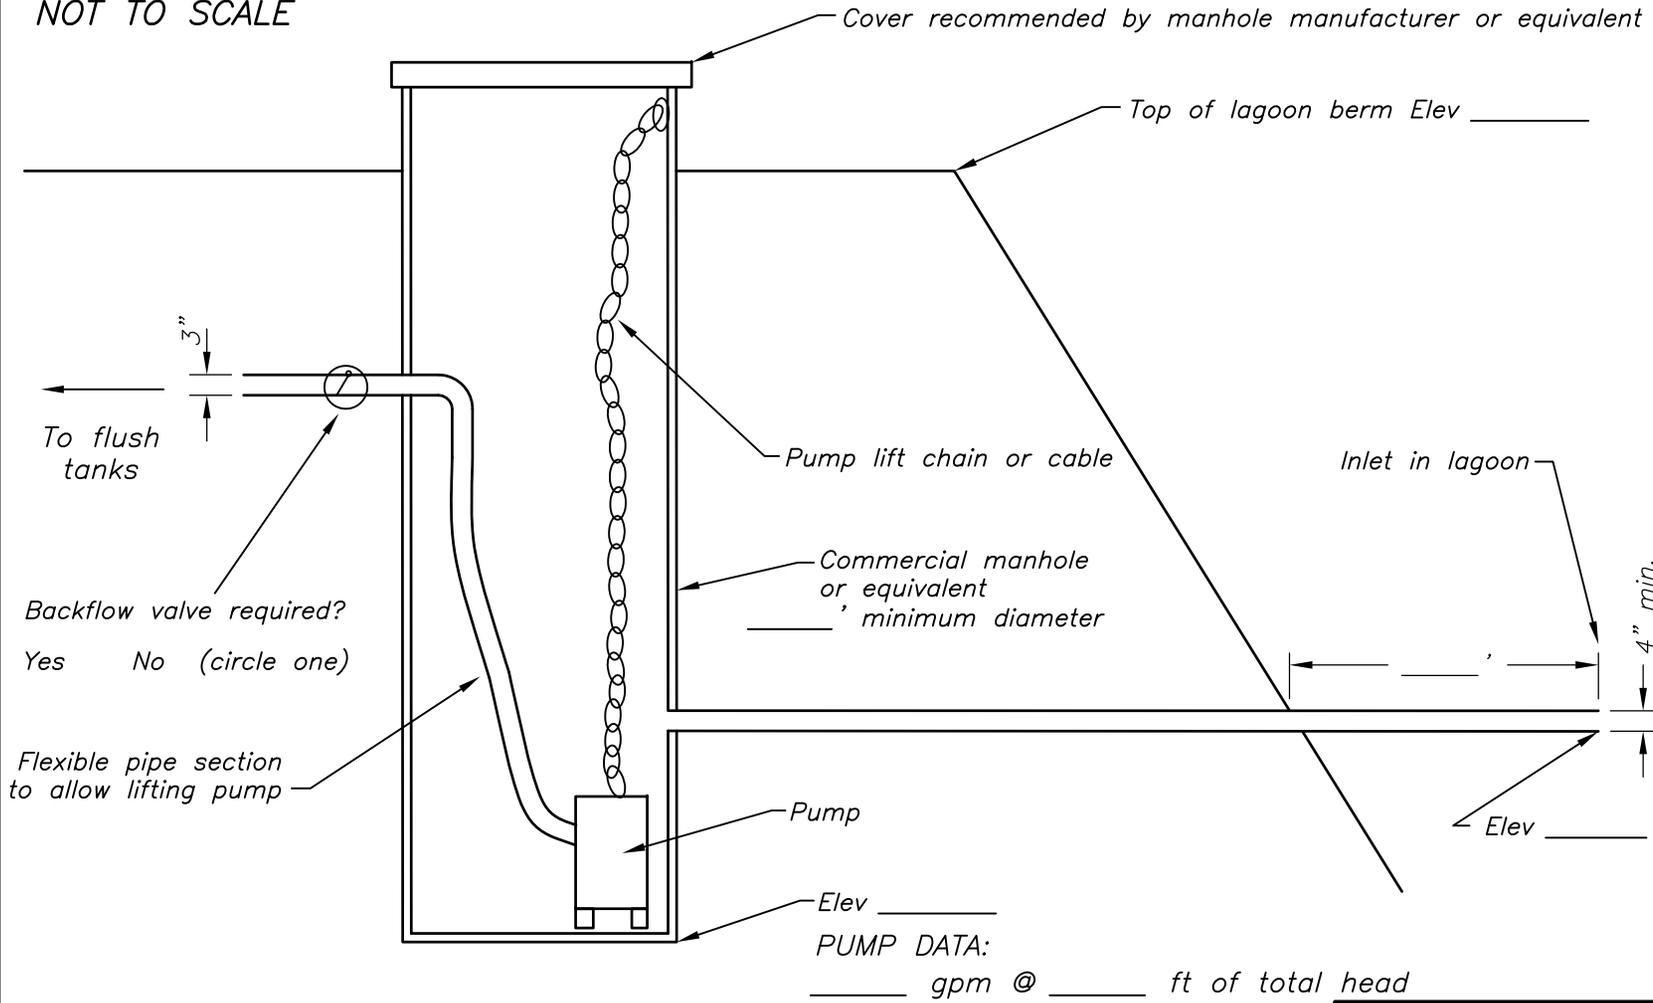

NOTES:

1. Pipes through the berm must be backfilled adequately to maintain the integrity of the clay liner.
2. The chain or cable shall be adequate to lift the pump without personnel entering the manhole.
3. Electrical wiring must comply with local codes and manufacturers requirements. Electrical plug to be located outside of manhole so that all electricity can be disconnected prior to pump service.
4. Return line to flush tanks must be protected from freezing and damage from livestock or equipment.

Revised 7/03

DRAFT
NOT FOR
CONSTRUCTION

Date	_____
Designed	_____
Drawn	_____
Checked	_____
Approved	_____

RECYCLE SUMP DETAILS



File Name	_____
Drawing Name	29-L-635
Sheet	of _____