


END VIEW

NOTES:

A 6" wide Concrete frost wall around perimeter of concrete floor to frost depth shall be considered where ground frost is a problem.

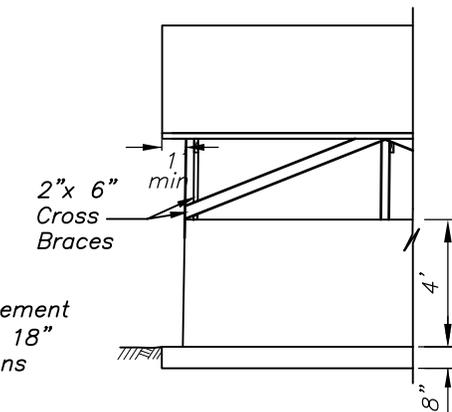


PARTIAL REAR ELEVATION

NOTES:

1. All lumber except rafters, purlins, knee braces/gussets & cross braces shall be pressure treated.
2. Attach purlins to rafters with manufactured framing anchors. Purlin joints shall overlap above rafters.
3. Attach cross braces to each post with 4-16d ring shank nails or 1 bolts with nut and 2 washers.

NOT TO SCALE

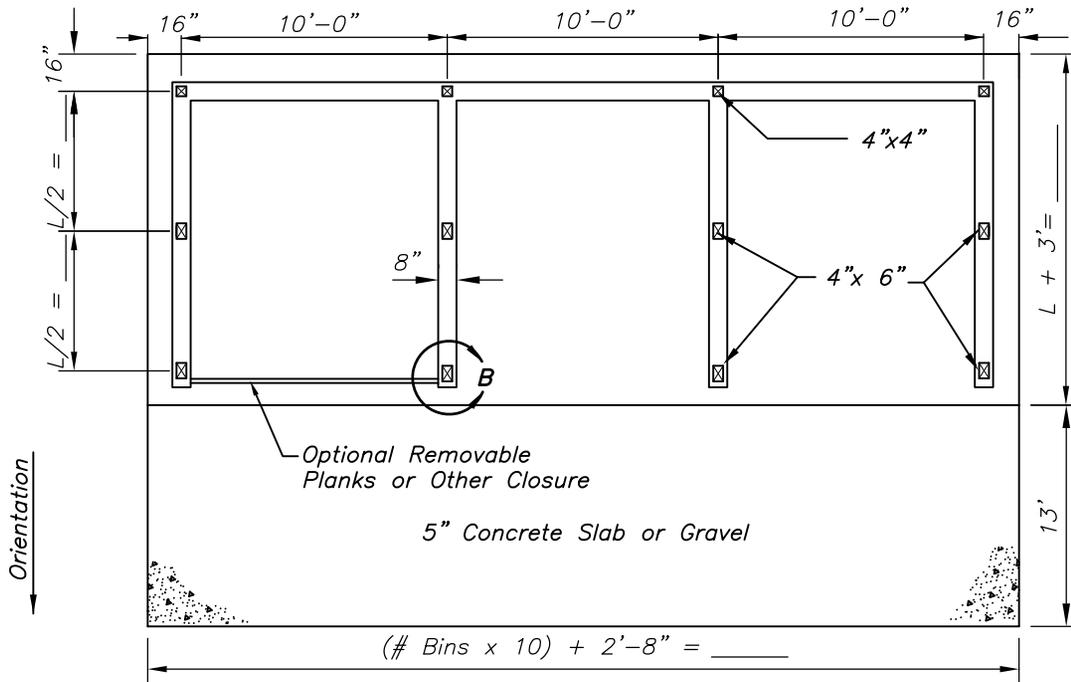

FLOOR PLAN

DRAFT
NOT FOR
CONSTRUCTION

Date	
Designed	
Drawn	
Checked	
Approved	

**SWINE COMPOSTING FACILITY
4' REINFORCED
CONCRETE STRUCTURE
GENERAL LAYOUT**



File Name	
Drawing Name	29-L-653