
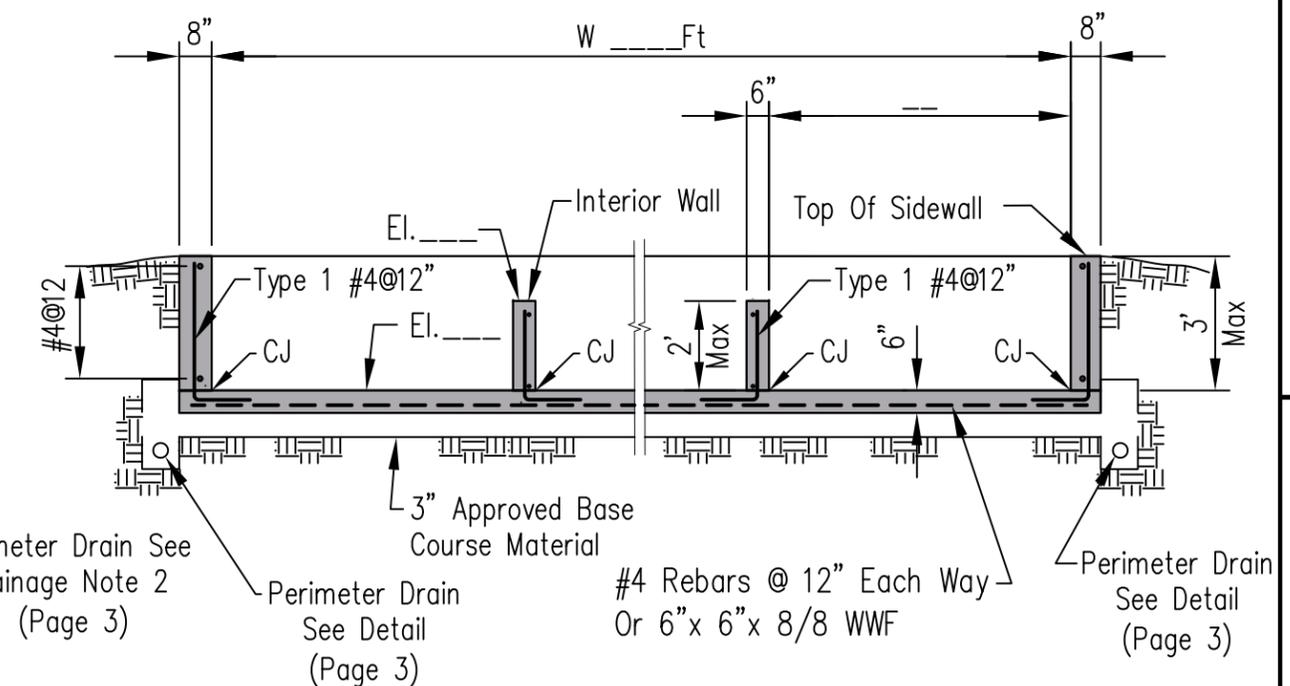


**PLAN**

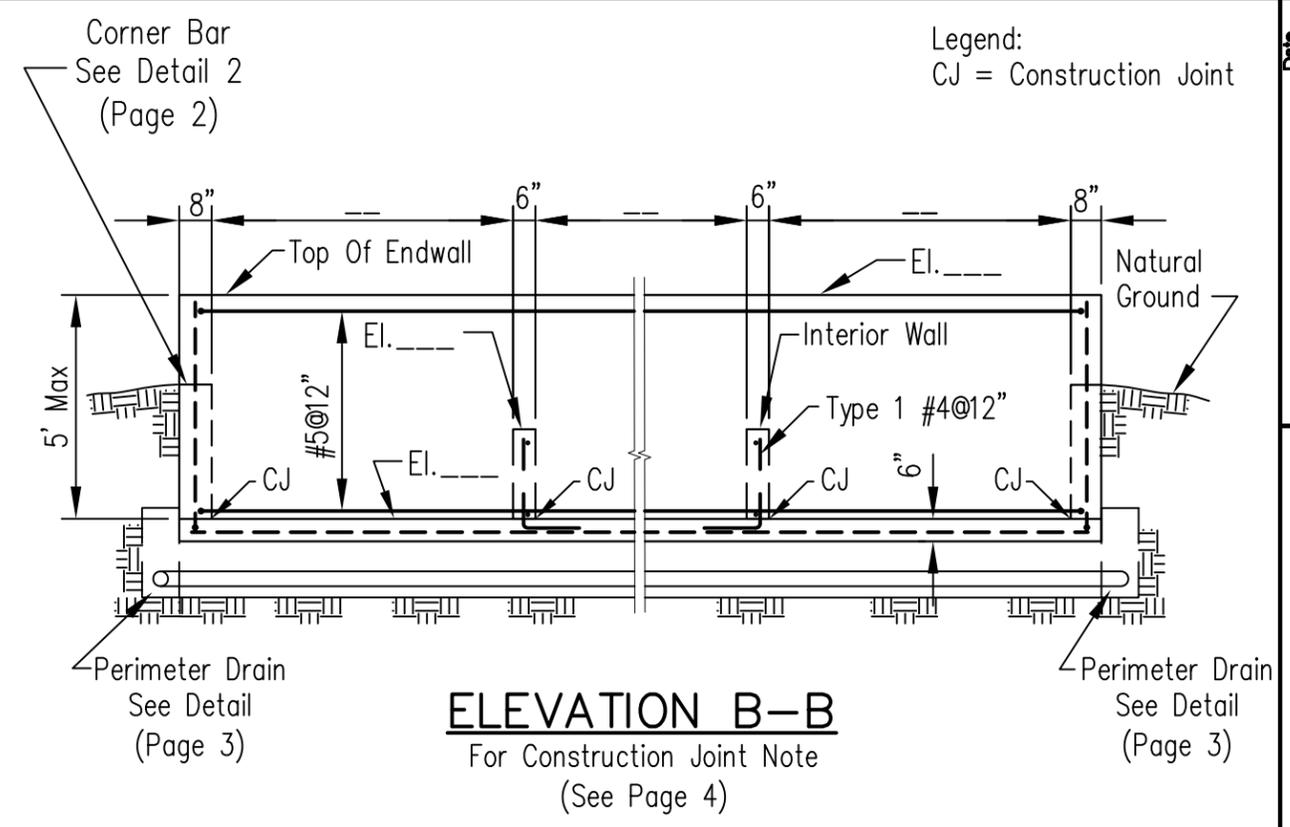

**SECTION C-C**  
For Construction Joint Note  
(See Page 4)

Legend:  
CJ = Construction Joint


|          |             |
|----------|-------------|
| Date     | 5/1/14      |
| Designed | M. QUINONES |
| Drawn    |             |
| Checked  |             |
| Approved |             |

**SAND SETTLING BASIN  
WITH INTERIOR WALLS**




|             |           |
|-------------|-----------|
| File No.    | IL-ENG-68 |
| Drawing No. |           |
| Page        | 1 of 4    |
| Sheet       | of        |

Not To Scale

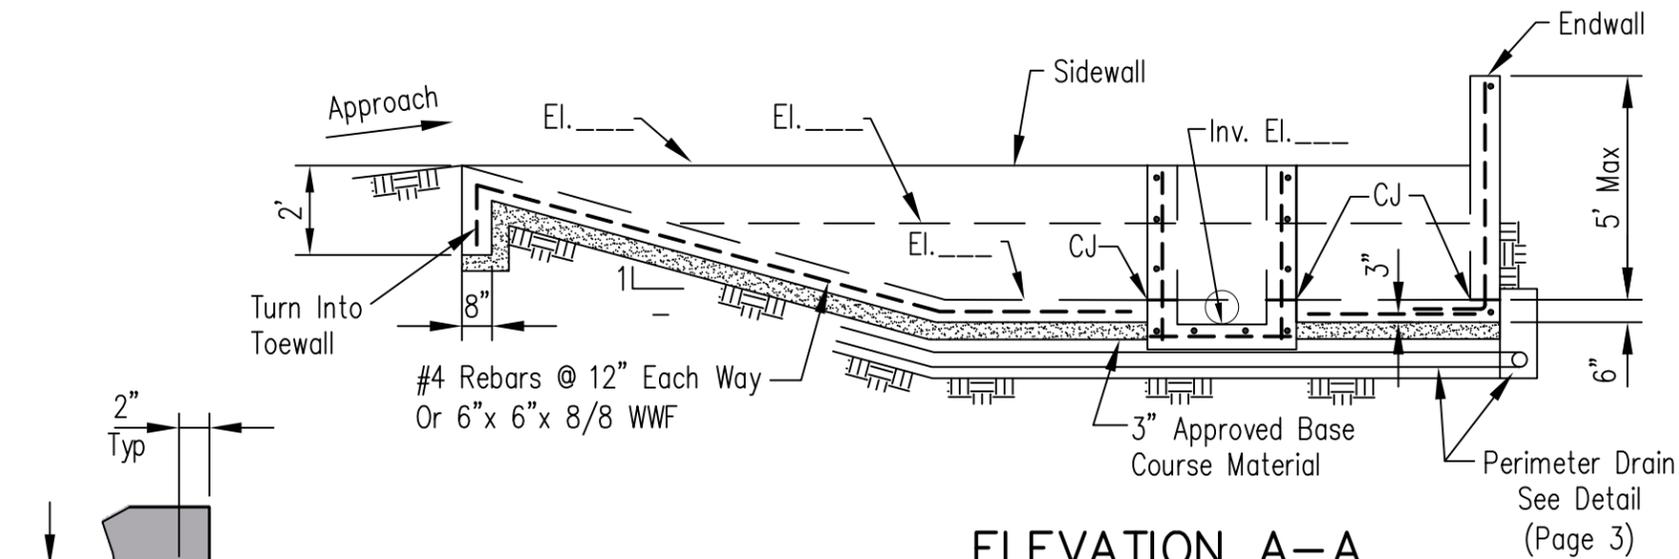


**ELEVATION A-A**

OUTLET BOX & PIPE  
For Construction Joint Note  
(See Page 4)

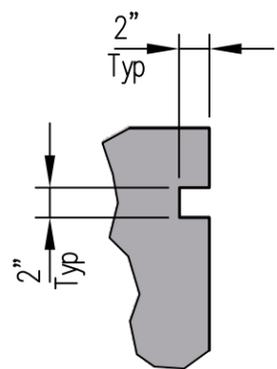


**DETAIL 1**

Scale 1" = 1'-0"

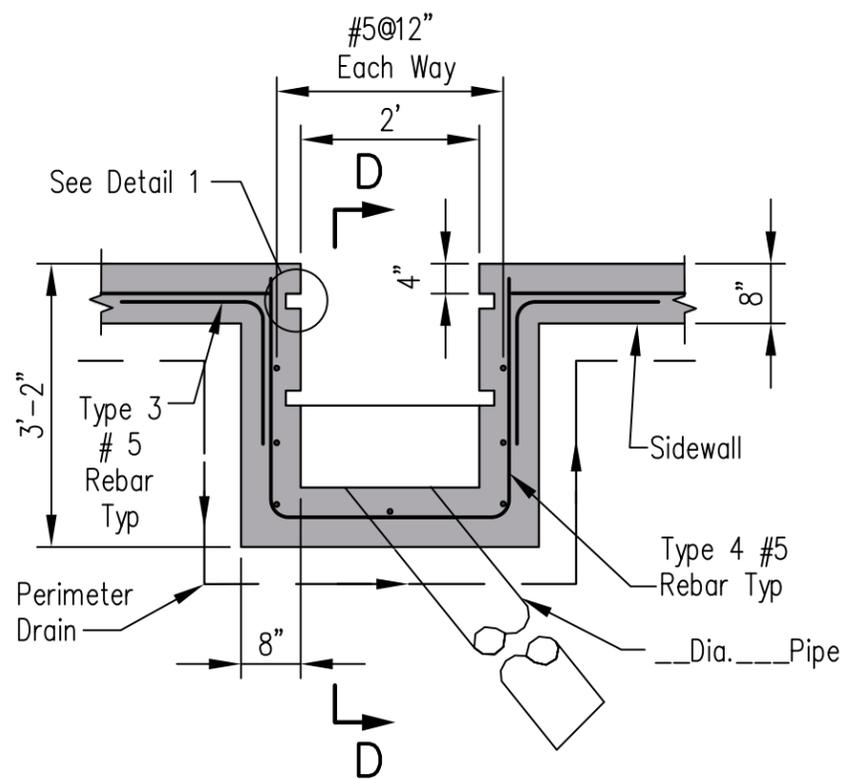

**PART PLAN A**

OUTLET BOX & PIPE Scale  
1/2" = 1'-0"

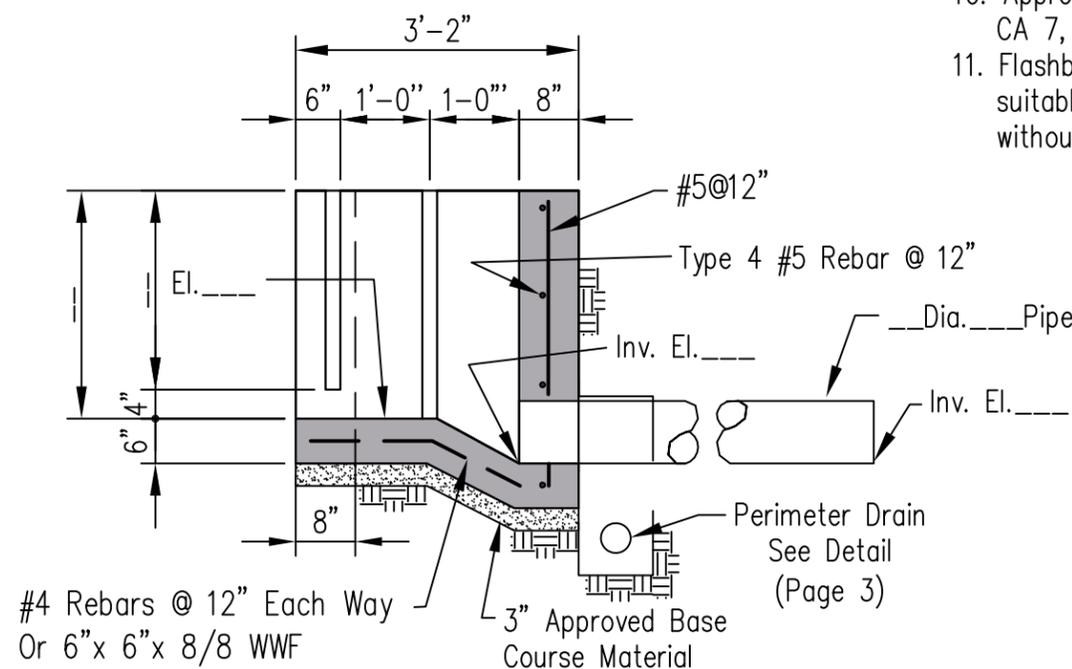


**SECTION D-D**

Scale 1/2" = 1'-0"

**GENERAL NOTES:**

1. Concrete shall be designed to provide a 28-day compressive strength of 4000 PSI. The concrete shall be placed with all the steel tied securely in place.
2. Steel in the floor shall be #4 rebars @ 12" center to center, each way, or 6"x 6"x 8/8 WWF.
3. The walls and floor will be built with expansion joints. No section of wall or floor will be over 30 foot long between expansion joints. See Expansion Joint Details.
4. A construction joint must be placed any where the concrete placement is not continuous. See Construction Joint Notes on page 4.
5. The rebars in the endwalls and outlet box shall be #5 rebars each way. The rebars in sidewalls and interior walls shall be #4 rebars, at 12 inches each way.
6. The vertical rebars in all the walls shall be bent 90 degrees with the shorter leg of rebar tied to the floor reinforcing. Where the #4 rebars join other #4 rebars, the bar lap shall be a minimum of 15 inches. The bar lap for #5 rebars to #5 rebars or #5 rebars to #4 rebars shall be 19 inches.
7. All rebars shall have a minimum concrete cover of 2 inches except when concrete is placed on or against the earth, then the minimum cover shall be three inches.
8. Field bend or cut vertical and horizontal bars in sidewalls and outlet box to clear pipe by a minimum of 2 inches.
9. PVC pipe shall meet the requirements of ASTM D-1785 PVC PLASTIC PIPE SCHEDULE 40 or 80.
10. Approved base course material includes IDOT Gradation No. CA 7, 8, 11, 12, 14, 15, 16 or FA 1, 2, 4.
11. Flashboards shall be constructed of treated lumber or other suitable material that could withstand exposure to manure without major corrosion and rot.

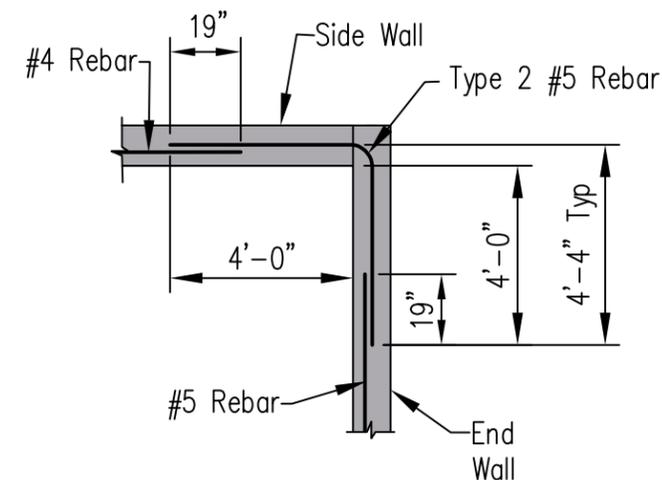

**DETAIL 2**

Corner Bar Detail



Not To Scale Unless Noted

|          |             |
|----------|-------------|
| Date     | 5/1/14      |
| Designed | M. QUINONES |
| Drawn    |             |
| Checked  |             |
| Approved |             |

SAND SETTLING BASIN WITH INTERIOR WALLS




|             |           |
|-------------|-----------|
| File No.    | IL-ENG-68 |
| Drawing No. |           |
| Page        | 2 of 4    |
| Sheet       | of        |

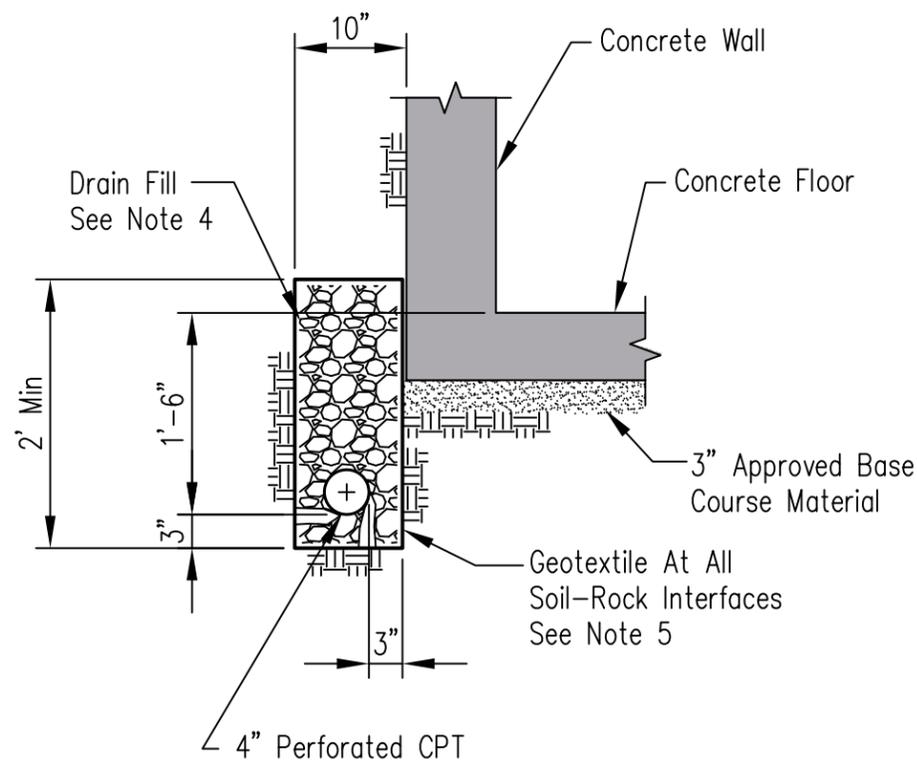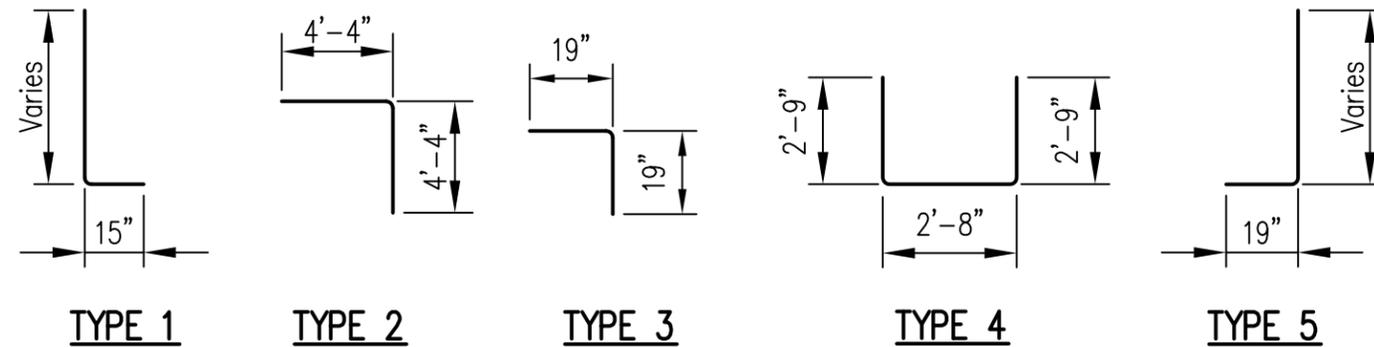

**PERIMETER DRAIN DETAIL**

Scale 3/4" = 1'-0"

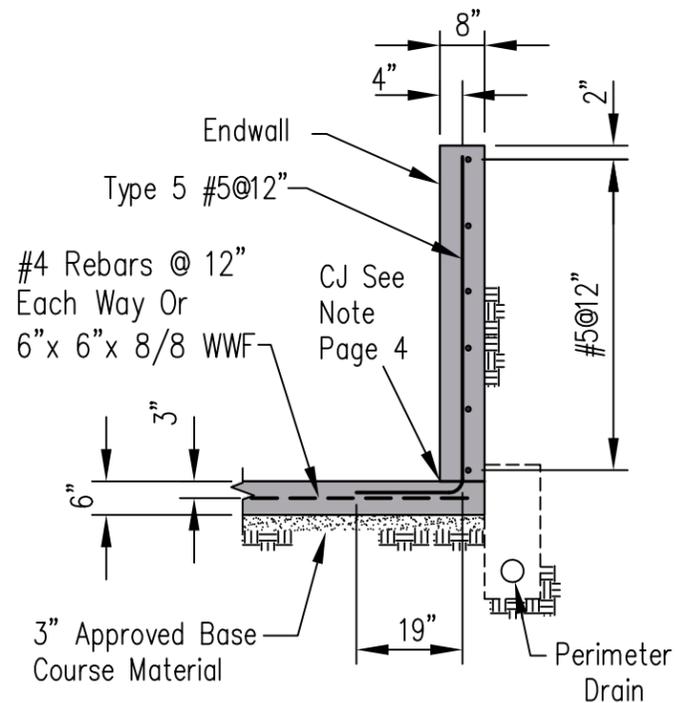

**SECTION E-E**

Scale 3/8" = 1'-0"

**DRAINAGE NOTES:**

1. Provide perimeter drain to adequate outlet if water table can rise above floor level.
2. Perimeter drain pipe and gravel/geotextile filter is to be routed around 3 sides of the basin and drain freely to a surface water outlet or other subsurface drainage outlet.
3. Perimeter drain pipe and fittings shall be perforated, corrugated polyethylene (CPT) meeting ASTM Specifications listed below:

|               |                               |
|---------------|-------------------------------|
| CPT           | ASTM F405, F667               |
| Dual Wall CPT | ASTM F2306, F2648, F405, F667 |

4. Drain fill shall consist of sand, gravel or concrete aggregate mixture with a maximum size of 3" and not more than 5% passing a #200 sieve. Qualifying IDOT gradations include:  
CA-1, CA-3, CA-5, CA-7, CA-8, CA-11, CA-12, CA-13, CA-14, CA-15, CA-16, CA-18
5. Geotextile (non-woven, needle punched) minimum criteria:  
Grab tensile strength (lb) ASTM D 4632 \_\_\_\_\_ 202  
Elongation at failure (%) ASTM 4632 \_\_\_\_\_ ≥50  
Trapezoidal tear strength (lb) ASTM D 4533 \_\_\_\_\_ 79  
Puncture strength (lb) ASTM D 6241 \_\_\_\_\_ 433  
Ultraviolet light (% retained strength) ASTM D 4355 \_\_\_\_\_ min 50  
Apparent opening size (AOS) ASTM D 4751 \_\_\_\_\_ max 0.22 mm (US sieve size 70)  
Permittivity sec<sup>-1</sup> ASTM D 4491 \_\_\_\_\_ min 0.70

| ESTIMATED QUANTITIES         |          |          |
|------------------------------|----------|----------|
| ITEM                         | UNIT     | QUANTITY |
| Concrete (28 Days, 4000 PSI) | Cu. Yd.  |          |
| Reinforcing Steel #4 Rebars  | Lbs.     |          |
| Reinforcing Steel #5 Rebars  | Lbs.     |          |
| Reinforcing 6"x6"x 8/8 WWF   | Sq. Ft.  |          |
| 6" Nonmetallic Water Stop    | Lin. Ft. |          |
| Inlet ___ Pipe ___ Dia.      | Lin. Ft. |          |
| Outlet ___ Pipe ___ Dia.     | Lin. Ft. |          |
| Base Course Material         | Tons     |          |
| Geotextile                   | Sq. Ft.  |          |
| Perimeter Drain Fill         | Tons     |          |
| 4" Perforated CPT            | Lin. Ft. |          |


Scale As Noted

**SAND SETTLING BASIN WITH INTERIOR WALLS**




File No. IL-ENG-68  
Drawing No. \_\_\_\_\_  
Page 3 of 4  
Sheet of \_\_\_\_\_


Date \_\_\_\_\_  
Designed \_\_\_\_\_  
Drawn M. QUINONES 5/1/14  
Checked \_\_\_\_\_  
Approved \_\_\_\_\_

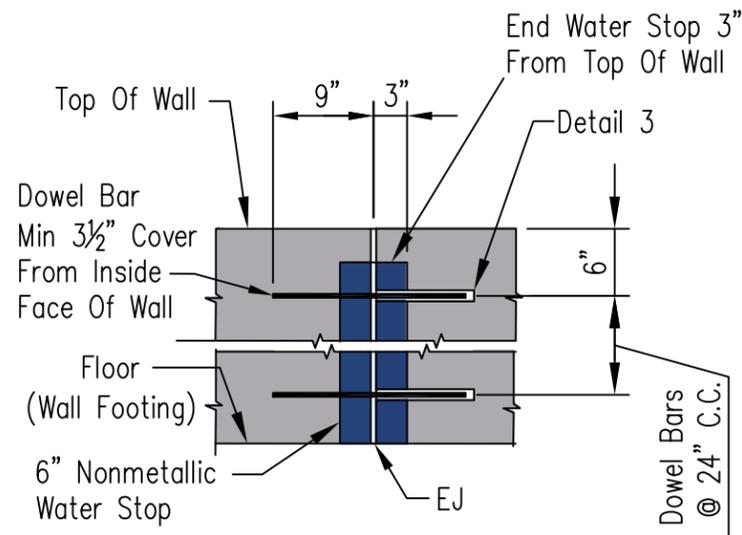

Spacing Not Greater Than 30' C.C.  
**EXPANSION JOINT**  
**DETAIL—WALL**  
 Scale 3/4" = 1'-0"

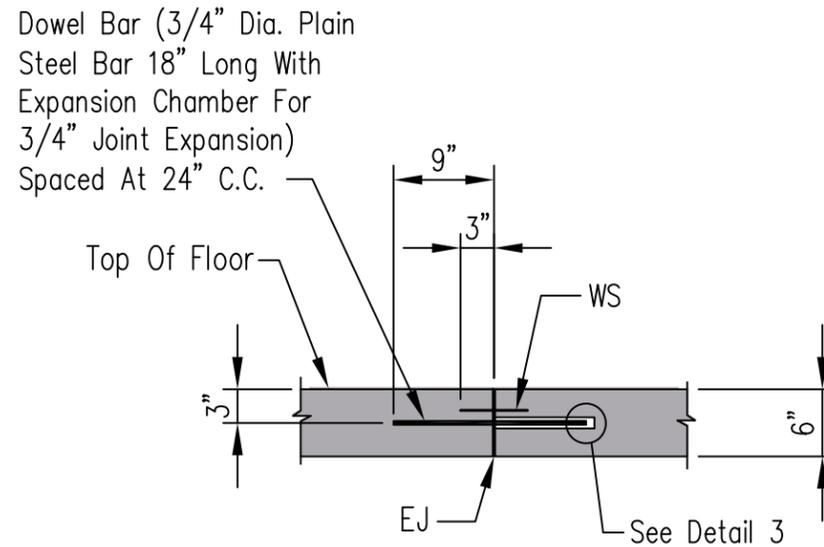

Spacing Not Greater Than 30' C.C.  
**EXPANSION JOINT**  
**DETAIL—FLOOR**  
 Scale 3/4" = 1'-0"

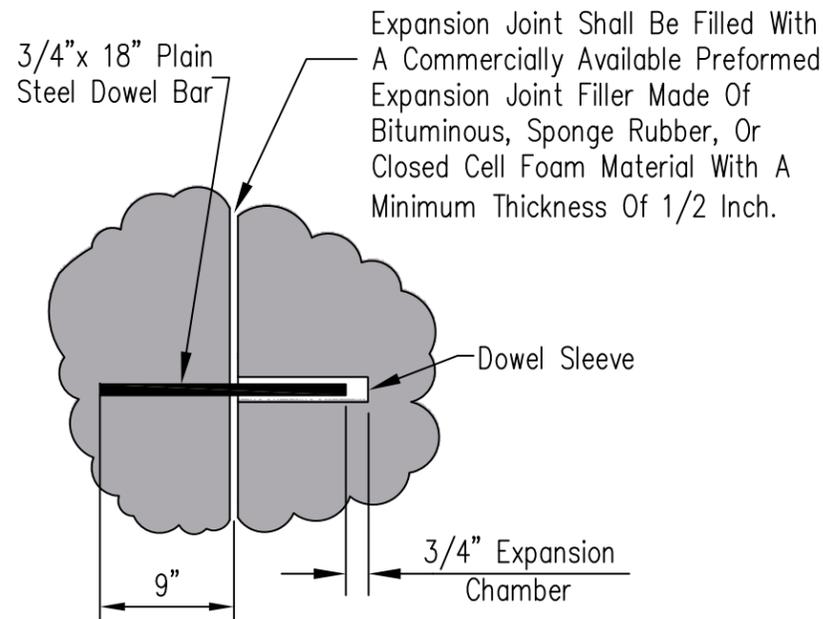

**DETAIL 3**  
 Scale 1" = 1'-0"

Construction Joint Notes

1. A construction joint must be prepared when the concrete pour is not continuous, typically between the floor and wall.
2. Prepare all surfaces that will be in contact with new concrete as per note 5.
3. Let concrete cure at least 12 hours prior to steel tying and form construction for the next pour.
4. New concrete must not be placed until the hardened concrete has cured at least 12 hours.
5. Construction joints must be prepared using one of following two methods:

Method 1 – Water–Air or Sandblasting. Clean the joint surface of all unsatisfactory concrete, laitance, coating, stains, and debris by sandblasting or high–pressure air–water cutting, or both. Sandblasting can be used after the concrete has gained sufficient strength to resist excessive cutting, and high–pressure air–water cutting can be used as soon as the concrete has hardened sufficiently to prevent the jet from displacing the coarse aggregates. The surface of the concrete in place must be cut to expose clean, sound aggregate, but not so deep as to undercut the edges of larger particles of the aggregate. Cut the surface to at least 1/4" depth. Thoroughly wash the surface to remove all material after cutting.

Method 2 – Mechanical. Clean the joint surface of all unsatisfactory concrete, laitance, coatings, stains, and debris by washing and scrubbing with a wire brush, wire broom, or other means approved by the engineer to expose coarse aggregate without displacing it. The surface must be roughened to at least 1/4" depth.

6. All construction joints must be wetted and standing water removed immediately before new concrete is placed.
7. New concrete must be sufficiently vibrated to ensure good contact into the prepared joint.
8. Keyways or steel plates cannot be substituted for the construction joint methods above.

**LEGEND**

- WS = 6" Nonmetallic Water Stop
- EJ = Expansion Joint
- CJ = Construction Joint

|          |             |
|----------|-------------|
| Date     | 5/1/14      |
| Designed | M. QUINONES |
| Drawn    |             |
| Checked  |             |
| Approved |             |

**SAND SETTLING BASIN  
 WITH INTERIOR WALLS**



|             |           |
|-------------|-----------|
| File No.    | IL ENG-68 |
| Drawing No. |           |
| Page        | 4 of 4    |
| Sheet       | of        |

Scale As Noted