

Notes:

- Pea gravel shall be clean naturally rounded with a mix of particle sizes not less than $\frac{1}{8}$ inch or more than $\frac{3}{4}$ inch. Crushed stone shall be washed with angular particle sizes not less than $\frac{1}{2}$ inch or more than $\frac{1}{2}$ inch.
- All buried steel tanks shall have some form of corrosion protection. Methods may include:
 - Coat with corrosion resistant coating and cathodically protected.
 - Coating shall be in accordance to AWWA D102
 - Cathodic protection shall be in accordance to NACE SP-0285
 - Bonding of steel tank with a thick layer of non-corrodible material.

Date _____

Designed _____


Checked _____

Approved _____

BURIED STORAGE TANK

OWNER: _____

COUNTY: _____

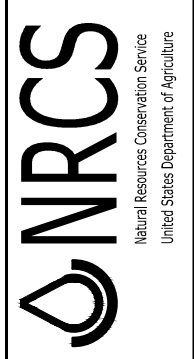

Drawing Number
ND-DWG-101

Date _____

Drawing Not To Scale

Sheet of _____