


Column Anchor - Use Simpson Strongtie CB Column Base (3 gauge min. thickness for straps and base), or equivalent. Min cover 3" at wall ends and corners.

Place building column, where applicable.

Free draining backfill material

\* Note: Use 12" thick walls where roof requires 12"x12" posts or 12" increase the outside thickness of 12" during the outside face of wall for a length of 18" at each post.

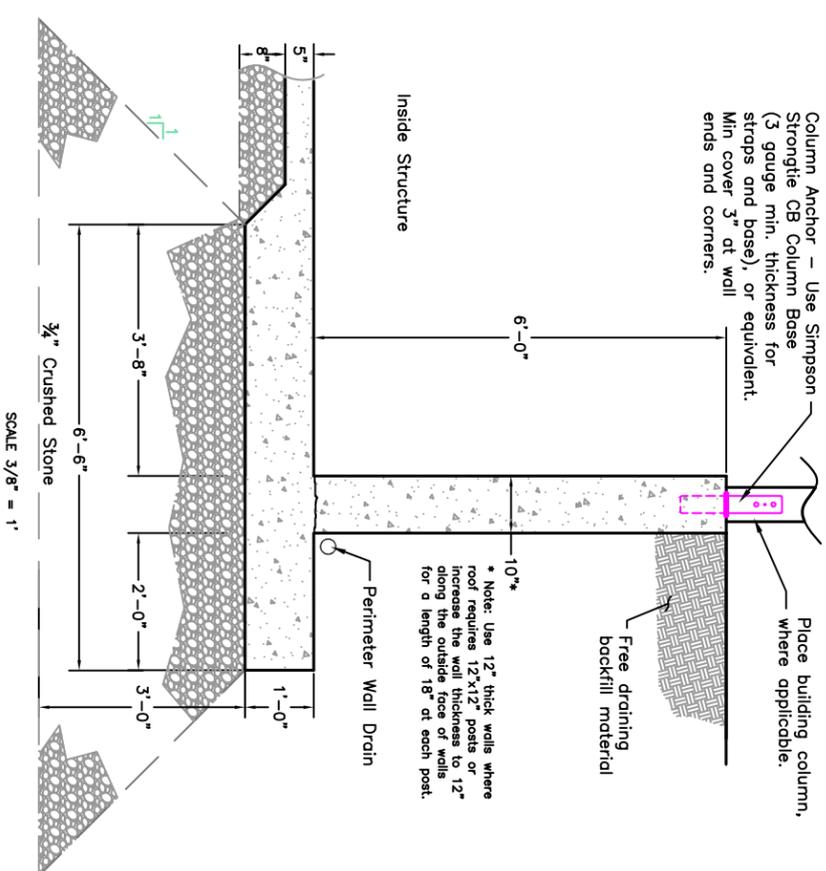

**CRUSHED STONE SPECIFICATION**

Crushed stone shall consist of durable crushed rock or durable crushed gravel stone, free from ice and snow, sand, clay, loam, or other deleterious or organic material. Crushed stone shall be used as bedding below slabs-on-grade and foundation wall footings with thickness as indicated on the drawings. Crushed stone shall be wrapped in non-woven filter fabric 6-oz/sy, placed in maximum 6-inch thick layers, loose measure, and compacted with a minimum of four (4) passes of a vibratory plate or roller compactor. The crushed stone shall be uniformly blended and shall conform to the following requirements:

Sieve Size	Percent Passing by Weight
1-inch	100
3/4-inch	90-100
5/8-inch	---
1/2-inch	10-50
3/8-inch	0-20
No. 4	0-5
No. 8	---


**STEEL SCHEDULE**

MARK	SIZE	QUANTITY	TYPE	A	B	LENGTH	TOTAL LENGTH
C1	4		Straight	-	-	7'-5"	
C2	5	21		6'-7"	10"	7'-5"	
C3	4	21		6'-7"	10"	7'-5"	
C4	5		Straight	-	-	6'-0"	
C5	4		Straight	-	-	6'-0"	
C6	4		Straight	-	-	6'-0"	
C7	4	22		3'-7"	4 7/8"	7'-6 7/8"	
C8	4		Straight	-	-	4'-6"	




\* 6 7/8" @ 12" WALL  
 \*\* 7'-8 7/8" @ 12" WALL  
 #4 BARS, TOTAL LENGTH = \_\_\_\_\_ X 0.668 LBS/FT. = \_\_\_\_\_ LBS  
 #5 BARS, TOTAL LENGTH = \_\_\_\_\_ X 1.043 LBS/FT. = \_\_\_\_\_ LBS  
 TOTAL REBAR = \_\_\_\_\_ LBS  
 CONCRETE = 0.426 CY/FT. OF WALL LENGTH ESTIMATED TOTAL = \_\_\_\_\_ CY  
 WASTE STORAGE FACILITY  
 6" HIGH WALL WITH COLUMNS  
 0' TO 6' BACKFILL

STANDARD DWG. NO. MA-WSF-11RF  
 DATE March 2013 SHEET 1 OF 1


NOTE: QUANTITIES OF STEEL SHOWN DO NOT INCLUDE LAP SPLICE OR DEVELOPMENT LENGTHS.

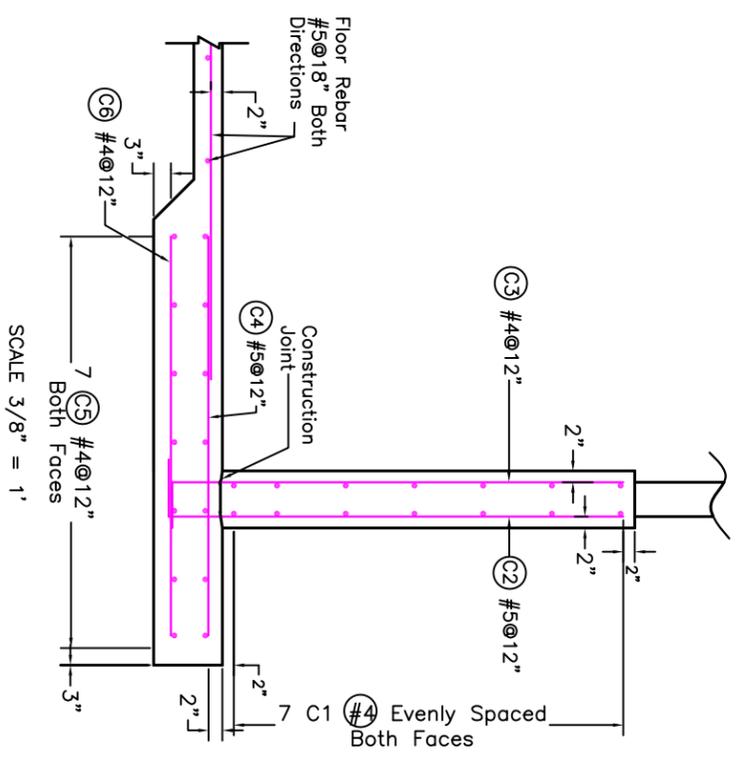

**WALL CORNER DETAIL**  
 NOT TO SCALE

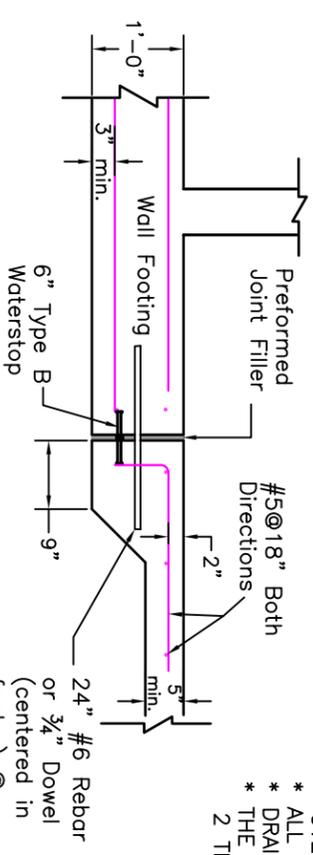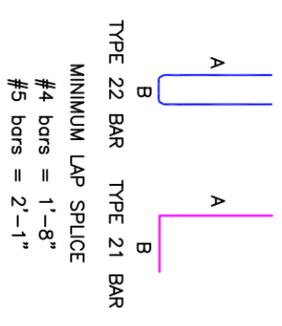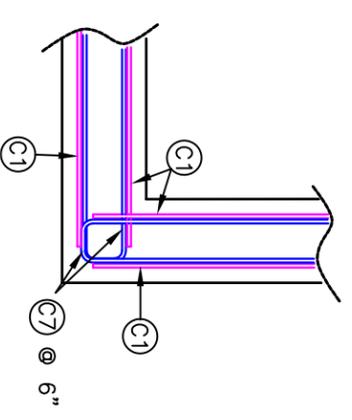


**OPTIONAL FLOOR DETAIL**  
 (minimum wall backfill of 4'-6" required)  
 NOT TO SCALE

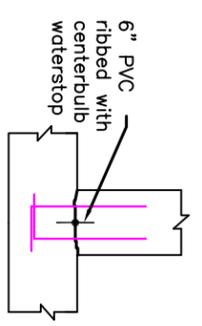

**CONSTRUCTION JOINT DETAIL**  
 NOT TO SCALE



**CORNER DETAIL (PLAN VIEW)**  
 SCALE 1/2" = 1'

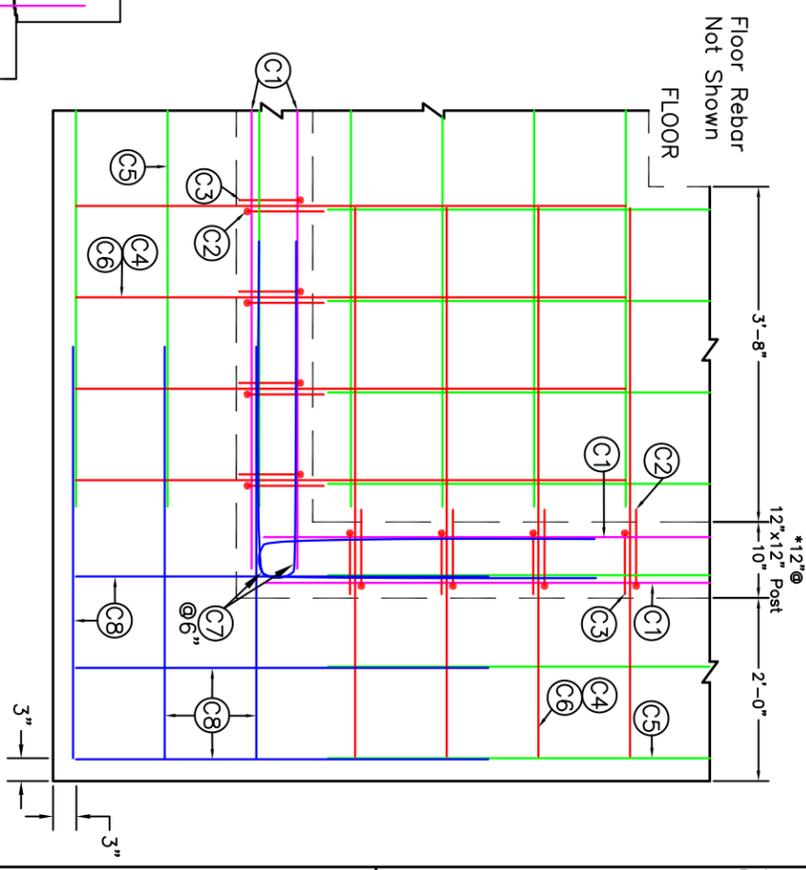

NOTE: All bars spaced 12" on center except where noted.  
 C7 - 22 bars per corner  
 C8 - 12 bars per corner

**WALL DESIGN LOADING**

- \* MANURE LOADING = 65 pcf
- \* BACKFILL: GRANULAR, NON-COHESIVE
- \* DENSITY = 120 pcf;  $\phi = 30^\circ$
- \* SURCHARGE = 2' OF BACKFILL EQUIVALENT (120 psf EFP REPRESENTING MACHINERY LOAD ON SOIL)

**CONSTRUCTION**

- \* CONTRACTION JOINTS SHALL BE PLACED IN WALLS AT A MAXIMUM SPACING OF 30'.
- \* EXPANSION JOINTS IN THE FLOOR SLABS SHALL BE A MAXIMUM OF 25'. THE SUBBASE MATERIAL UNDER THE SLAB SHALL BE 3/4" CRUSHED STONE AS INDICATED ON THE DRAWINGS. SEE PROJECT DRAWINGS AND SPECS FOR ADDITIONAL SUBBASE REQUIREMENTS.
- \* UNLESS OTHERWISE SHOWN, PROVIDE A MINIMUM OF 2" OF CONCRETE COVER OVER ALL STEEL.
- \* ALL CONTRACTION AND EXPANSION JOINTS SHALL HAVE WATERSTOPS.
- \* DRAINAGE SHALL BE DIRECTED AWAY FROM THE WALL.
- \* THE TOP WIDTH OF THE BACKFILL AROUND THE WALL SHALL BE AT LEAST 2 TIMES THE BACKFILL HEIGHT.

**CONDITIONS OF USE**

- \* STANDARD DRAWING - DESIGNER MUST ENSURE THE APPLICATION OF THIS DRAWING MEETS THE ASSUMPTIONS OF THE DESIGN AS STATED.
- \* MAXIMUM ROOF SPAN OF 50'; MAXIMUM EAVE HEIGHT (TOP OF FOOTER TO BOTTOM OF TRUSS) OF 14'; AND MAXIMUM COLUMN SPACING OF 8'.
- \* BACKFILL HEIGHT = 0' TO 6' (4' RECOMMENDED FOR FROST).
- \* FOOTING MUST BE RESTRAINED WITH A FLOOR SLAB.
- \* DRAINAGE CONDITION: FULL DRAINAGE, EITHER BY COARSE WELL DRAINED BACKFILL OR A DRAINAGE SYSTEM.
- \* MINIMUM SUBGRADE BEARING CAPACITY = 2,000 psf
- \* CONCRETE STRENGTH = 4,000 psi REBAR = GRADE 60